


SANUI

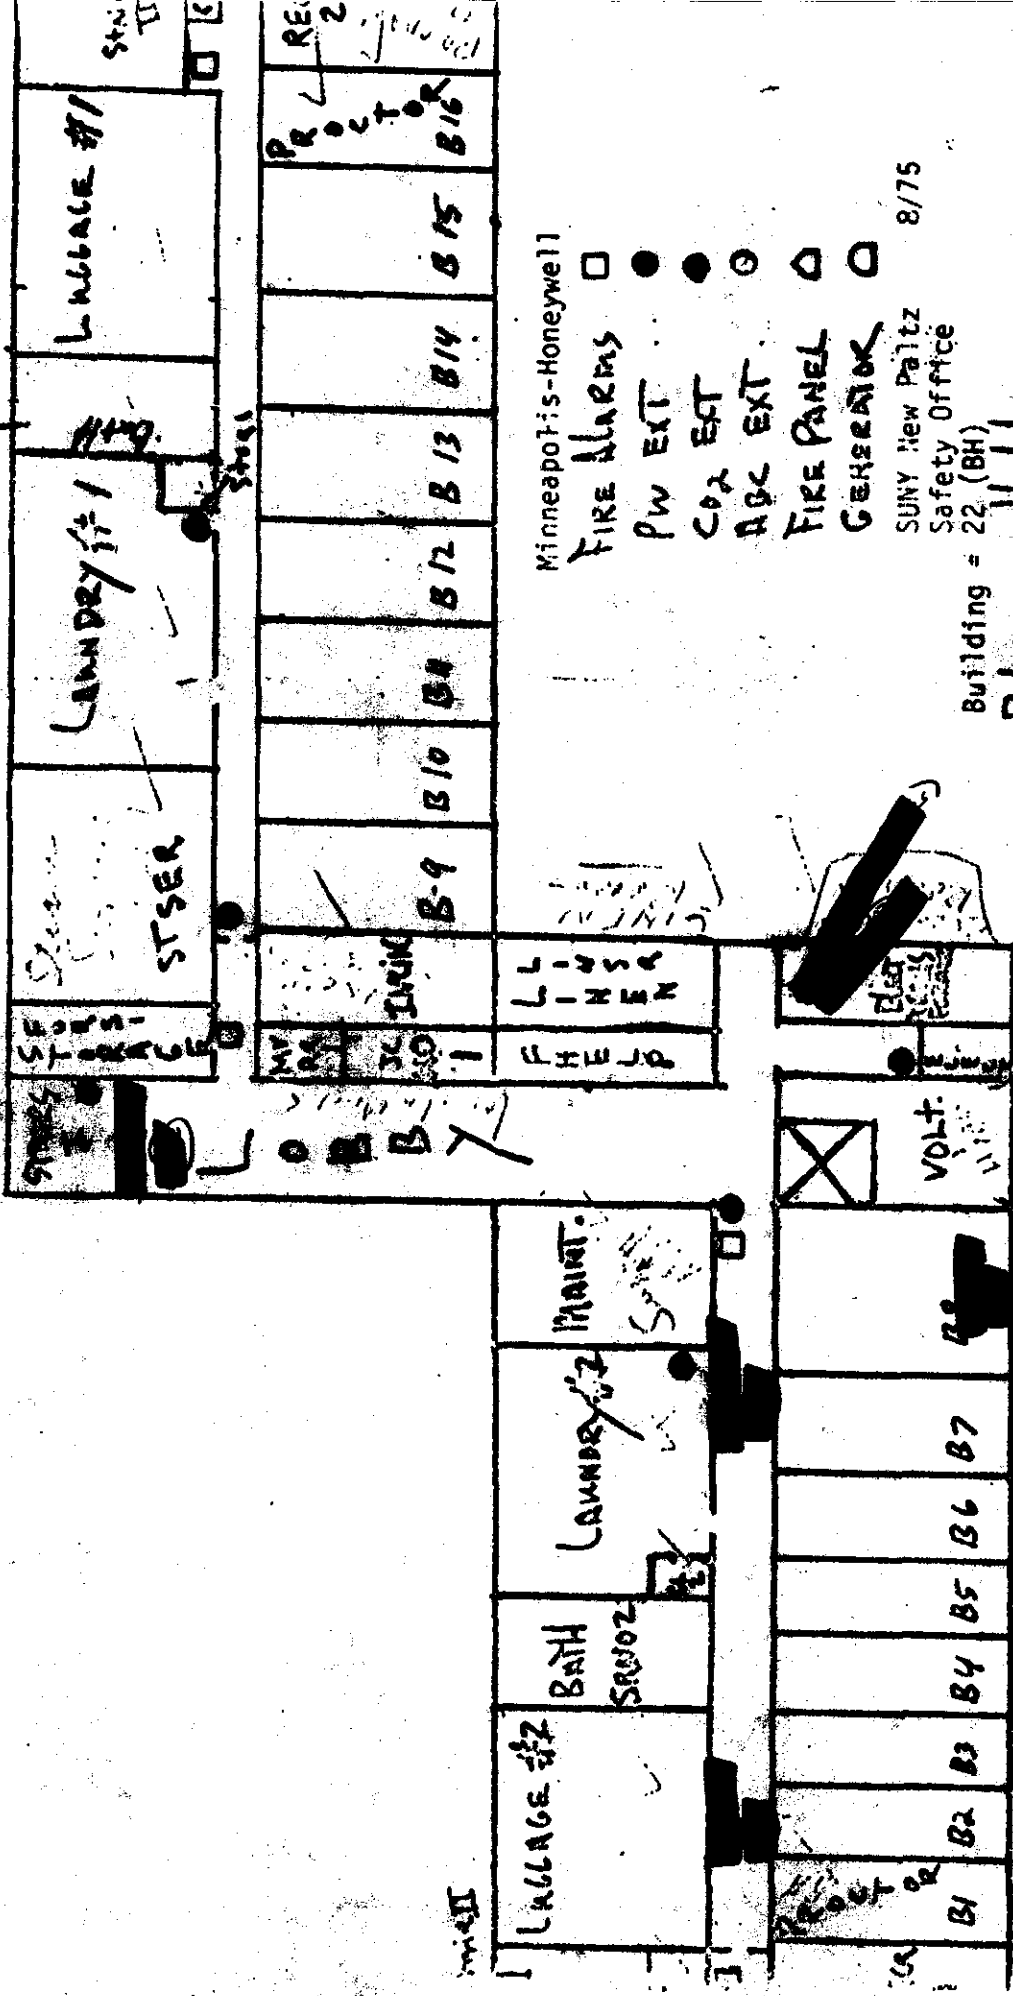

Minneapolis-Honeywell

- FIRE ALARMS
- PW EXT
- CO2 EXT
- ABC EXT
- FIRE PANEL
- GENERATOR

8/75

SUNY New Paltz
Safety Office


Building = 22 (BH)

BLISS HALL


BASEMENT

NORTH




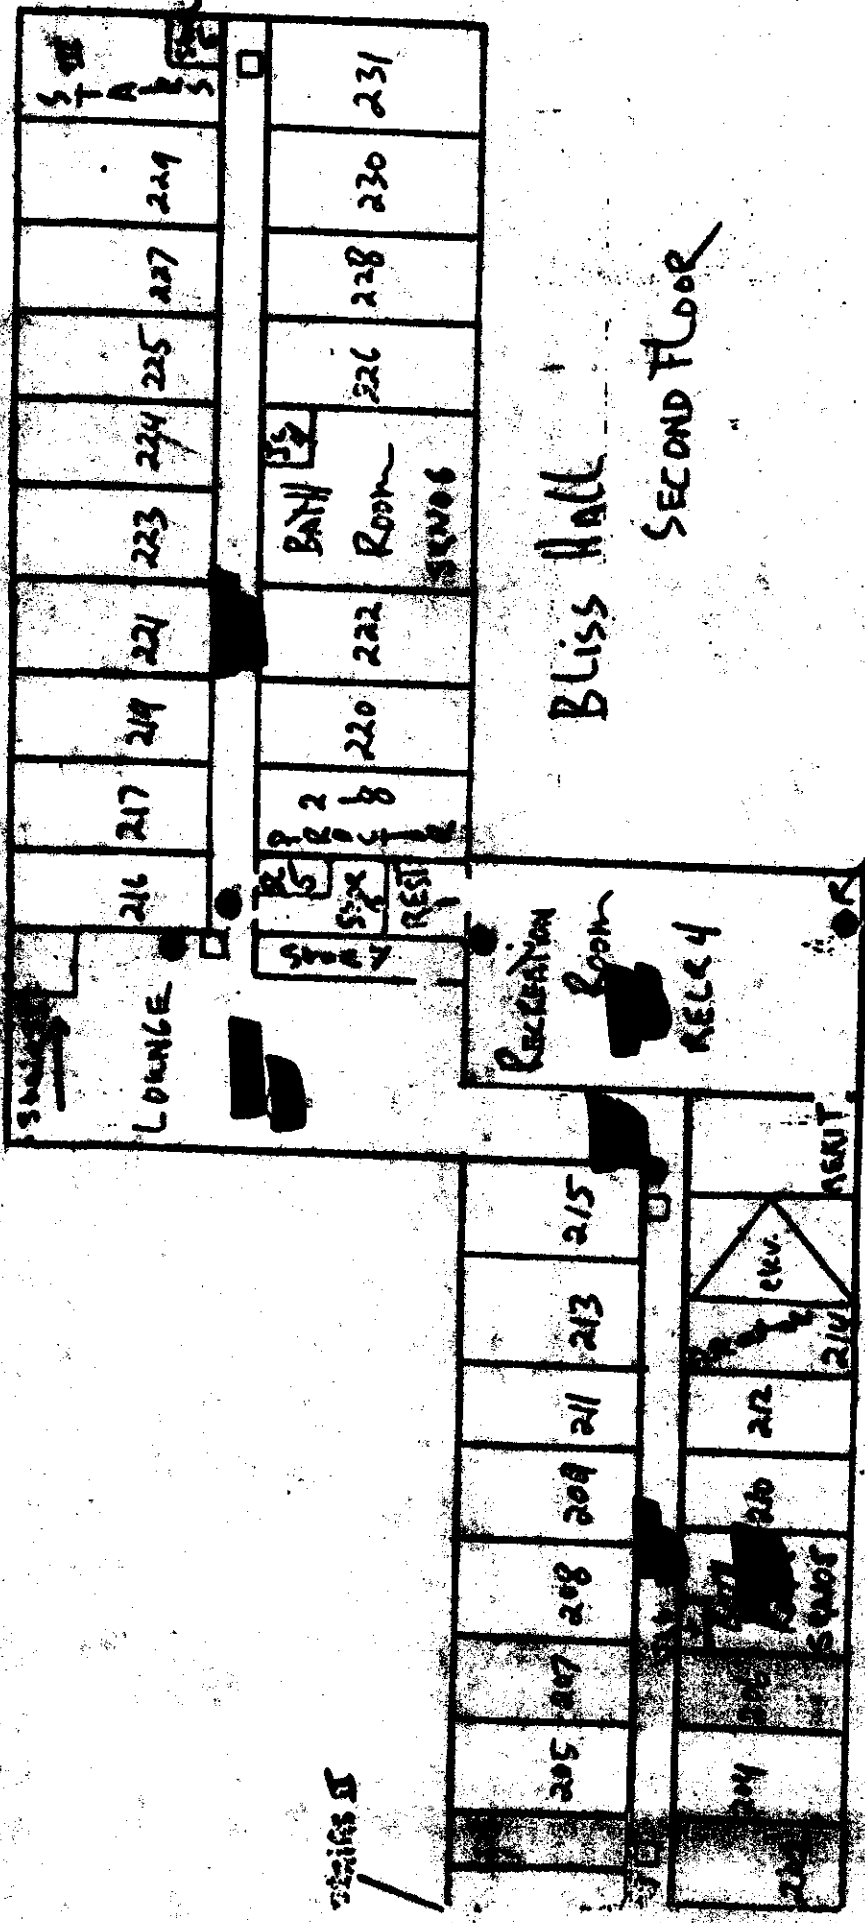

North
↓

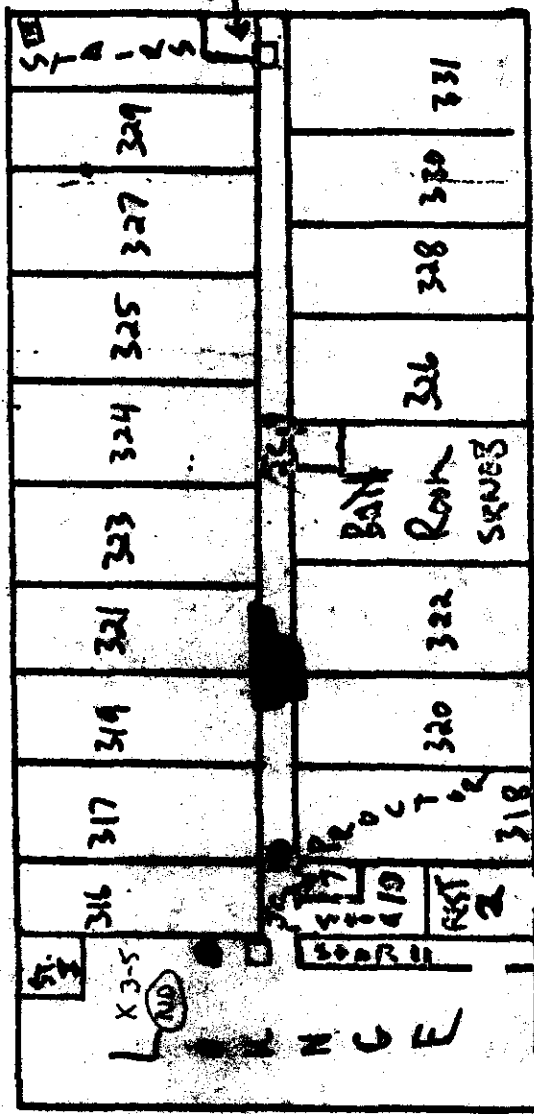

BLISS HALL
THIRD FLOOR

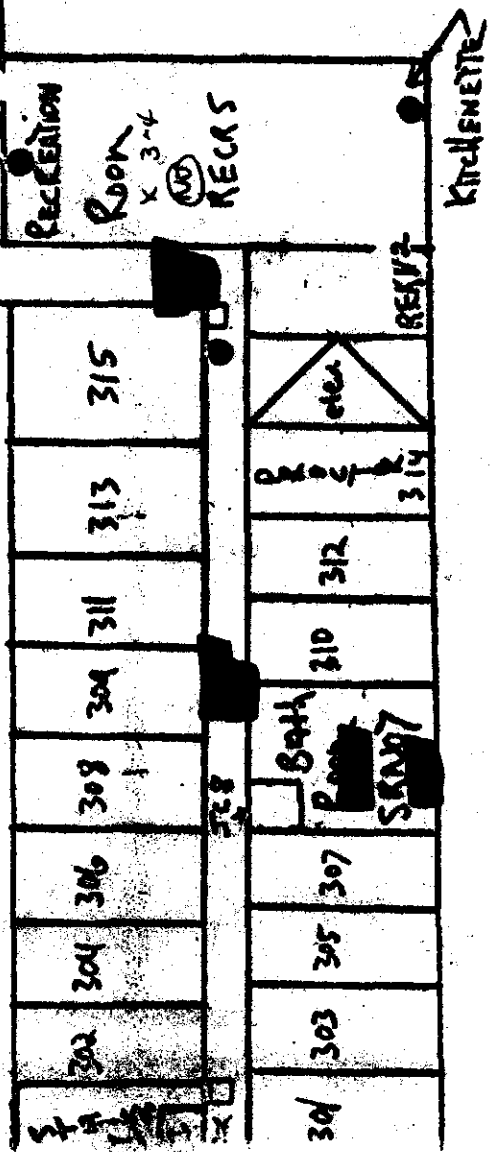

→



Clean Harbors
ANALYTICAL SERVICES
325 WOOD ROAD, BRAINTREE, MA 02184
(617) 849-6070

REPORT OF ANALYSIS

Clean Harbors of Kingston, Inc.
New York Division
P.O. Box 1812
Albany, NY 12201

Project: SUNY - NEW PALTZ COLLEGE
P.O. #: A-8820

Date Received: 01/03/92
CHAS Lab #: 9201025

Attn: Mr. George Cebula

Enclosed are the results for the sample(s) delivered to our laboratory on the date indicated above.

The methods listed represent those methodologies which were used to develop the best analytical techniques. Analytical results and quality assurance protocols are based on these guidelines. These meet the requirements for the reporting of results under the RCRA, NPDES and Safe Drinking Water Act regulations.

Clean Harbors Analytical Services has an active program of quality assurance and quality control. The program closely follows the guidance provided in the EPA Contract Laboratory Program Statement of Work (organic and inorganic), the guidance provided in SW-846, and many other pertinent documents.

Should you have any questions concerning this work, please do not hesitate to contact me.

The information contained in this report is, to the best of my knowledge, accurate and complete.

Per/Date: Jeanne M. Engel
Jeanne M. Engel
Laboratory Manager



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: BLISS-2, POLY OUT SIDE ENTRAN.
Sample Type: Water

CHAS Lab #: 9201025-02N
Date Received: 01/03/92

Polychlorinated Biphenyls (PCBs)
by EPA Method 608

Extraction Date: 01/03/92
Analysis Date: 01/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	3.0	ND	ug/l
PCB - Aroclor 1221	3.0	ND	ug/l
PCB - Aroclor 1232	3.0	ND	ug/l
PCB - Aroclor 1242	3.0	ND	ug/l
PCB - Aroclor 1248	3.0	ND	ug/l
PCB - Aroclor 1254	3.0	ND	ug/l
PCB - Aroclor 1260	3.0	29	ug/l

Notes: ND - Below minimum detectable level (MDL)
Soil/solid sample results based on sample dry weight

QA/QC

Surrogate Recovery	Acceptance Criteria
Hexabromobenzene: 88.2%	34-104%



QUALITY CONTROL

REPORT OF ANALYSIS

CHAS LAB. NO. 9201025

The attached quality control data was generated during the analysis of these samples. The sample data has been corrected for analytes found in the blank (if any). Corrections were performed in accordance with the procedures as stated in the Clean Harbors Analytical Laboratory QA/QC Manual and pertinent SOP's, which are available for review. This data is submitted for informational purposes only.



Client: Clean Harbors of Kingston, Inc.

CHAS Lab #: 9201025

Polychlorinated Biphenyls (PCB's) Blank

by EPA Method 608 (ref. f)

Extraction Date: 01/03/91

Analysis Date: 01/04/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/l
PCB - Aroclor 1221	1.0	ND	ug/l
PCB - Aroclor 1232	1.0	ND	ug/l
PCB - Aroclor 1242	1.0	ND	ug/l
PCB - Aroclor 1248	1.0	ND	ug/l
PCB - Aroclor 1254	1.0	ND	ug/l
PCB - Aroclor 1260	1.0	ND	ug/l

Note: ND - Below minimum detectable level (MDL)
Soil/solid sample results based on sample dry weight

QA/QC Surrogate Recoveries:

Hexabromobenzene : 91.5%

Acceptance Criteria:

Water Soil
34-104% 78-148



Client: Clean Harbors of Kingston, Inc.

CHAS Lab #: 9201025

Polychlorinated Biphenyls (PCB's) Blank

by EPA Method 600/4-81-045 (ref. d)

Extraction Date: 01/03/91

Analysis Date: 01/03/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	mg/kg
PCB - Aroclor 1221	1.0	ND	mg/kg
PCB - Aroclor 1232	1.0	ND	mg/kg
PCB - Aroclor 1242	1.0	ND	mg/kg
PCB - Aroclor 1248	1.0	ND	mg/kg
PCB - Aroclor 1254	1.0	ND	mg/kg
PCB - Aroclor 1260	1.0	ND	mg/kg

Note: ND - Below minimum detectable level (MDL)
Soil/solid sample results based on sample dry weight



Clean Harbors
ANALYTICAL SERVICES
325 WOOD ROAD, BRAINTREE, MA 02184
(617) 849-6070

REPORT OF ANALYSIS

Clean Harbors of Kingston, Inc.
New York Division
P.O. Box 1812
Albany, NY 12201

Project: SUNY - NEW PALTZ COLLEGE
P.O. #: A-8820

Date Received: 12/31/91
CHAS Lab #: 9112304

Attn: Mr. George Cebula

Enclosed are the results for the sample(s) delivered to our laboratory on the date indicated above.

The methods listed represent those methodologies which were used to develop the best analytical techniques. Analytical results and quality assurance protocols are based on these guidelines. These meet the requirements for the reporting of results under the RCRA, NPDES and Safe Drinking Water Act regulations.

Clean Harbors Analytical Services has an active program of quality assurance and quality control. The program closely follows the guidance provided in the EPA Contract Laboratory Program Statement of Work (organic and inorganic), the guidance provided in SW-846, and many other pertinent documents.

Should you have any questions concerning this work, please do not hesitate to contact me.

The information contained in this report is, to the best of my knowledge, accurate and complete.

Per/Date:


Robert E. Bentley
Laboratory Manager

2 Jan. '92



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: BLISS-1, BLISS VAULT TRANSF.
Sample Type: Oil

CHAS Lab #: 9201025-01N
Date Received: 01/03/92

Polychlorinated Biphenyls (PCBs)
by EPA Method 600/4-81-045

Extraction Date: 01/03/92
Analysis Date: 01/03/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	50000	ND	mg/kg
PCB - Aroclor 1221	50000	ND	mg/kg
PCB - Aroclor 1232	50000	ND	mg/kg
PCB - Aroclor 1242	50000	ND	mg/kg
PCB - Aroclor 1248	50000	ND	mg/kg
PCB - Aroclor 1254	50000	ND	mg/kg
PCB - Aroclor 1260	50000	1000000	mg/kg

Notes: ND - Below minimum detectable level (MDL)
Soil/solid sample results based on sample dry weight



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: B-1, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-01N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 12/31/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	38	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: B-2, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-02N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 12/31/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	120	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: B-3, ELISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-03N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 12/31/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	12	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: B-4, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-04N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 12/31/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	8.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-1, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-05N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-2, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-06N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-3, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-07N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	11	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-4, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-08N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	42	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-6, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-10N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2-1, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-11N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	7.0	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-5, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-09N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2-2, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-12N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	28	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2-3, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-13N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	90	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2-4, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-14N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2-5, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-15N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	3.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2-6, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-16N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	2.7	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 3-1, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-17N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	55	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 3-2, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-18N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	56	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 3-3, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-19N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	73	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 3-4, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-20N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 3-5, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-21N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 3-6, BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9112304-22N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	2.0	ND	ug/100 sq cm
PCB - Aroclor 1221	2.0	ND	ug/100 sq cm
PCB - Aroclor 1232	2.0	ND	ug/100 sq cm
PCB - Aroclor 1242	2.0	ND	ug/100 sq cm
PCB - Aroclor 1248	2.0	ND	ug/100 sq cm
PCB - Aroclor 1254	2.0	ND	ug/100 sq cm
PCB - Aroclor 1260	2.0	4.8	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



QUALITY CONTROL

REPORT OF ANALYSIS

CHAS LAB. NO. 9112304

The attached quality control data was generated during the analysis of these samples. The sample data has been corrected for analytes found in the blank (if any). Corrections were performed in accordance with the procedures as stated in the Clean Harbors Analytical Laboratory QA/QC Manual and pertinent SOP's, which are available for review. This data is submitted for informational purposes only.



Client: Clean Harbors of Kingston, Inc.

CHAS Lab #: 9112304

Polychlorinated Biphenyls (PCB's) Blank

Extraction Date: 12/31/91

Analysis Date: 01/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	ND	ug/100 sq cm

Note: ND - Below minimum detectable level (MDL)
Soil/solid sample results based on sample dry weight

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Clean Harbors Analytical, 325 Wood Rd., Greentree, Pa. 02184

CHAIN OF CUSTODY RECORD

Sample Custodian - (617) 849-6070

Page 1 of 2

Client: CHI Albany Project Name: SUNY New Paltz College Project P.O. #: 18820 Date: 12/31/91

Report To: CHI Albany Address: PO BOX 1812 Albany NY 12201 Phone #: (518) 434-0199

Invoice To: CHI Albany Address: _____ By: Pete Motes Date Samples Received: 12-31-91

Date Samples Collected: 12/31/91 NOTE: Samples received unpreserved will be preserved upon arrival at CHAS. Samples used: Preserved Unpreserved

Alcohol/Bill of Lading? Y N

Bliss Hall Sample I.D.	Sampling Information			Sample Type	PCB	Sew	Analysis										# of con.	Comments (Special instructions, cautions, etc.)	Date Sample #	
	Date	Time	Station Location																	
B-1	12/31	3:00	Bliss Hall	Wipe	V															12/31 KD 4112304
B-2	12/31	"	"	"	V															02N
B-3	"	"	"	"	V															03N
B-4	"	"	"	"	V															04N
1-1	"	"	"	"	V															05N
1-2	"	"	"	"	V															06N
1-3	"	"	"	"	V															07N
1-4	"	"	"	"	V															08N
1-5	"	"	"	"	V															09N
1-6	"	"	"	"	V															10N
2-1	"	"	"	"	V															11N

Relinquished by: _____ Date: _____ Time: _____

Received by: _____ Date: _____ Time: _____

Standard laboratory turnaround time is 2 weeks from date of receipt. Accelerated turnaround may be assessed a surcharge. Accelerated turnaround requested: _____ Surcharge: _____

REMARKS: (Sample storage, nonstandard sample bottles, special instructions)
 PCB Wipe Samples
 24hr Turnaround
 4x4 wipe area 100cm²

Location of samples: LAB
 Turnaround: 24 hrs 48 hrs 1 week 2 weeks Other: _____

CleanHarbors

CHS Analytical, 455 Ford Rd., Andover, MA 02184 CHAIN OF CUSTODY RECORD Sample Custodian - (617) 549-6070 Page 2 of 2

Client: CHT Albany Project Name: SUNY NEW PALTZ College Project A 8520 Date: 12/31/91

Address: PO Box 1812 Albany NY 12201 Phone #: (516) 434-0119

Indicate to: CHT Albany Address: _____ by: Pedro Montes Date Samples Received: 12/31/91

Date Samples Collected: 12/31/91 NOTE: Samples received unpreserved will be preserved upon arrival at CHS. Samples were: Preserved (Unpreserved)

Bliss Hall Sample I.D.	Sampling Information			Sample Type	Pres.	Analysis						# of con.	Comments (Special instructions, cautions, etc.)	CAS Sample #	
	Date	Time	Station Location			PCB	SKIN								
2-2	12/31	3:00	Bliss Hall	Wipe	✓										1220
2-3	"	"	"	"	✓										1320
2-4	"	"	"	"	✓										1420
2-5	"	"	"	"	✓										1520
2-6	"	"	"	"	✓										1620
3-1	"	"	"	"	✓										1720
3-2	"	"	"	"	✓										1820
3-3	"	"	"	"	✓										1920
3-4	"	"	"	"	✓										2020
3-5	"	"	"	"	✓										2120
3-6	"	"	"	"	✓										2220


Delivered by: Pedro Montes VOA Vial: 11

Received by: _____ Time: _____ Preservation Key: A - Acidified with _____


Standard laboratory turnaround time is 2 weeks from date of receipt. Accelerated turnaround may be assessed surcharge. Accelerated turnaround requested: _____ Surcharge: _____

REMARKS: (Sample storage, nonstandard sample bottles, special instructions)
 4x4 wipe area 100 cm²
 PCB Wipe Samples
 24hr Turnaround


Location of samples: _____ Turnaround: 24 hrs 48 hrs 1 Week 2 Weeks Other _____

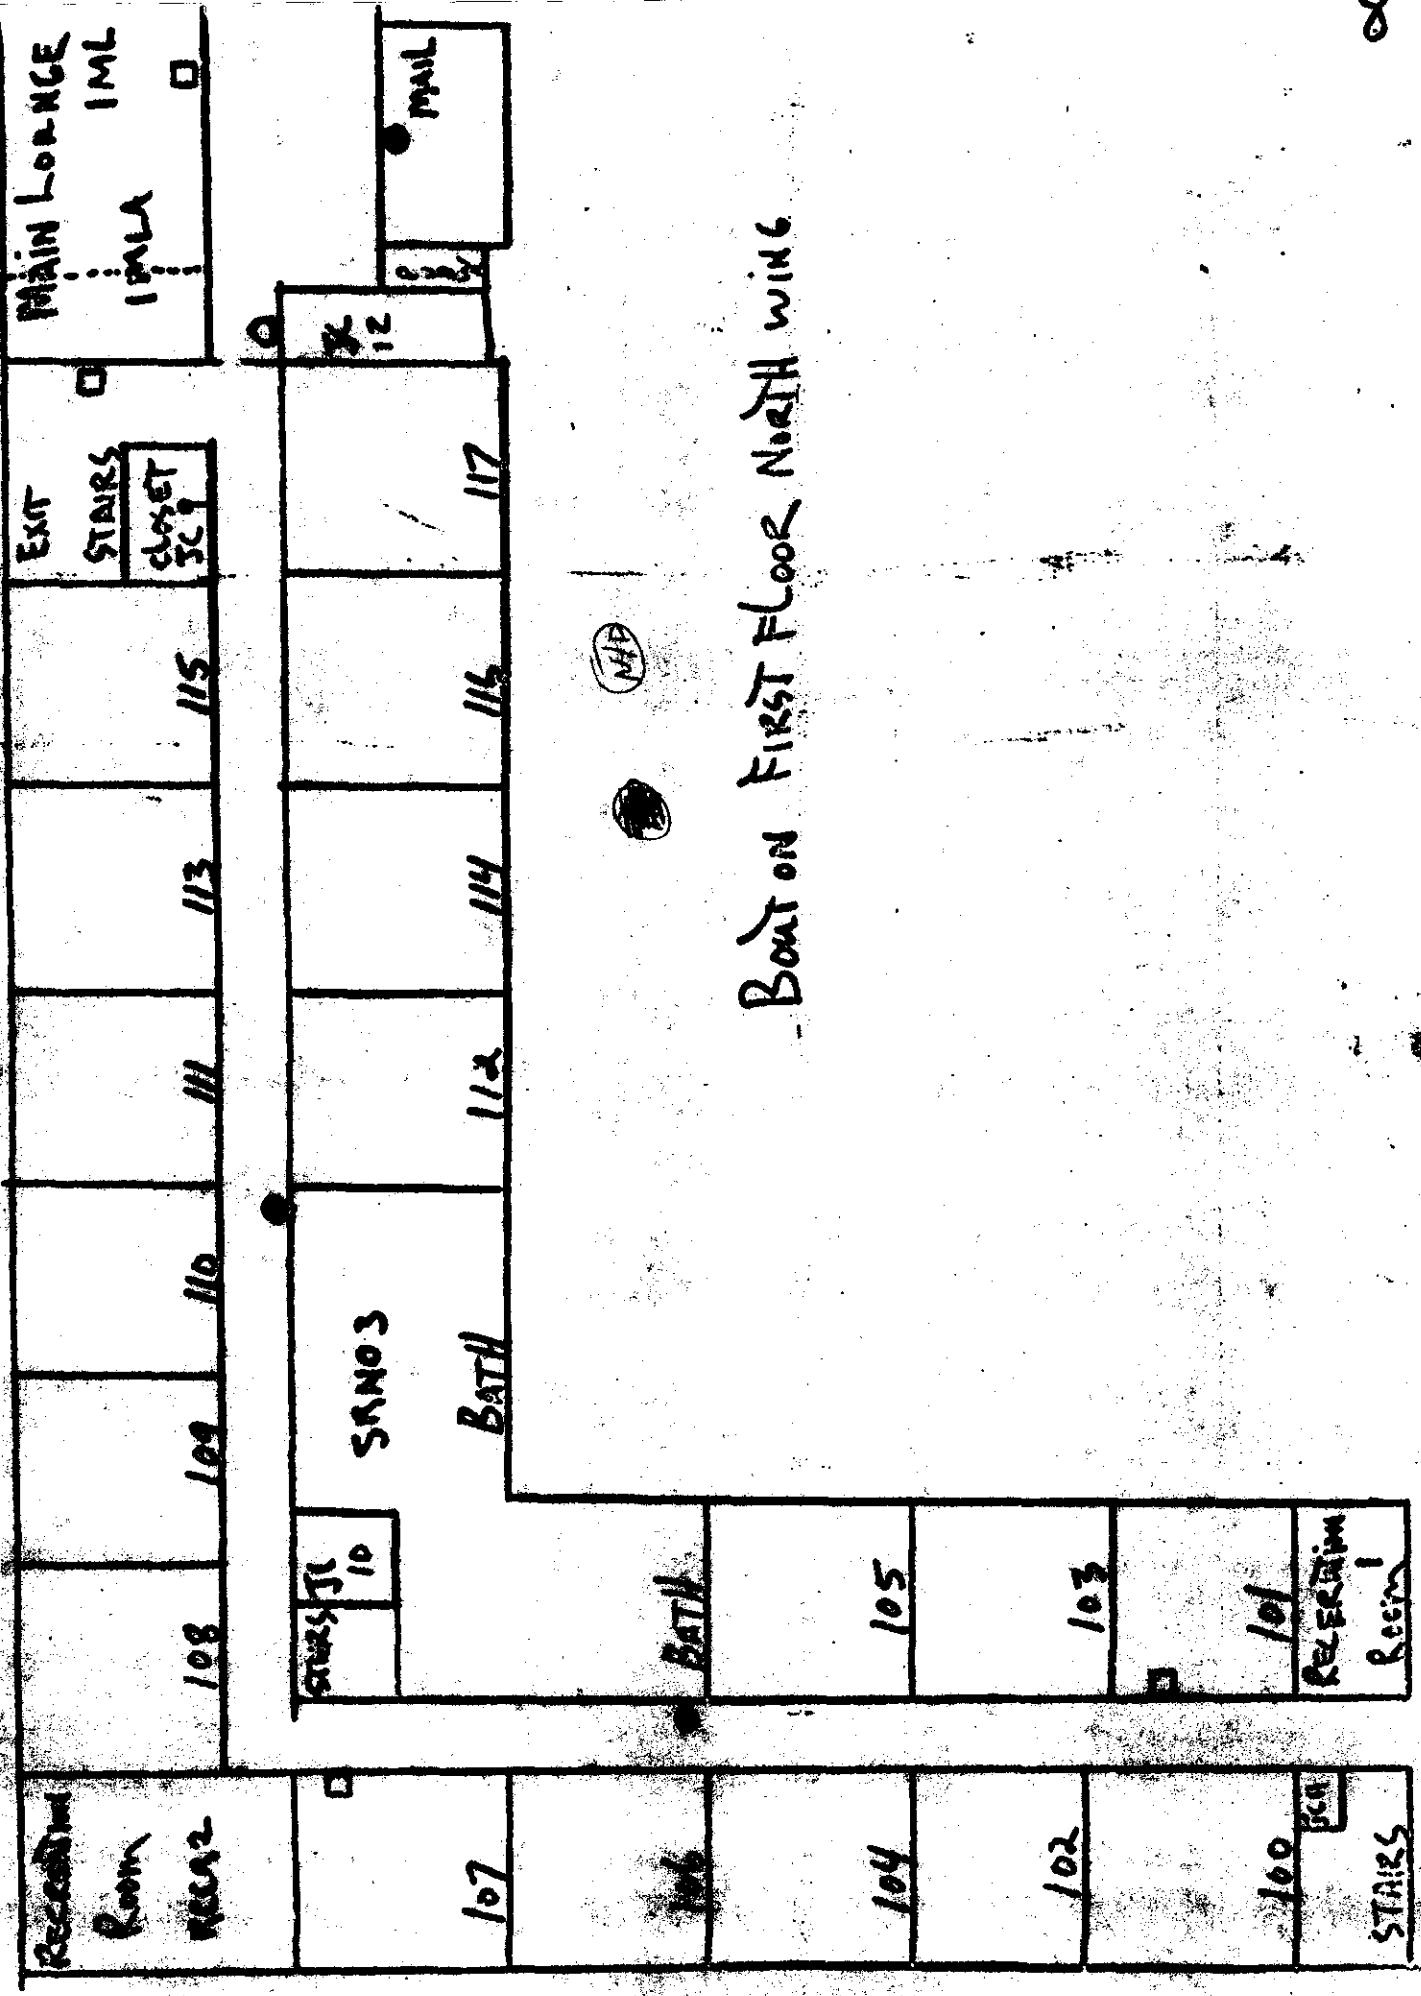

BOAT ON FIRST FLOOR NORTH WING

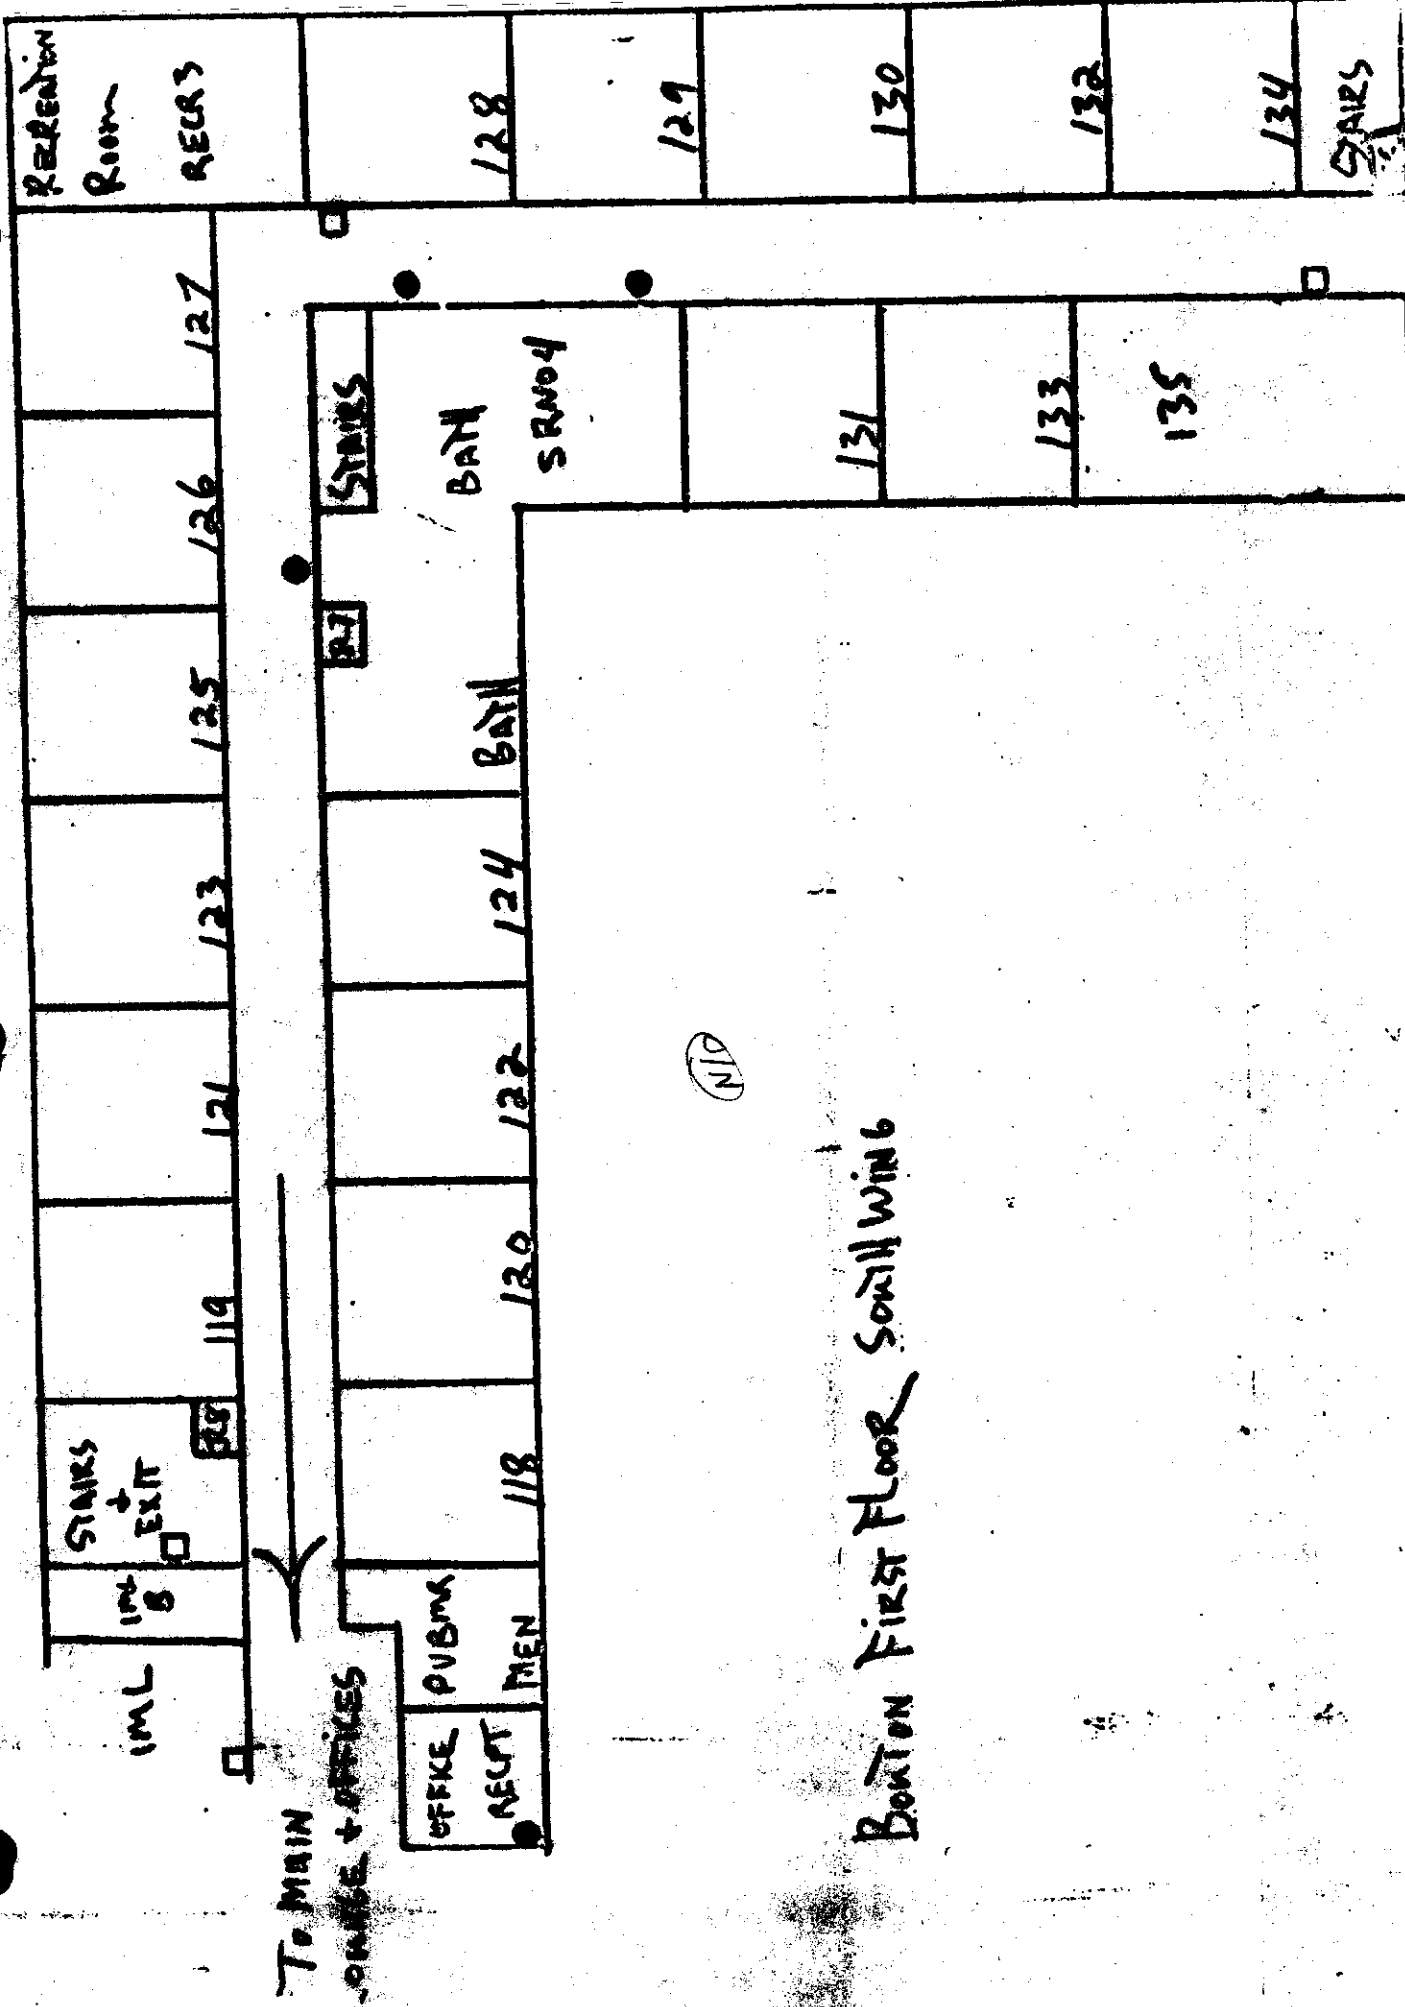



Boston First Floor South Wing

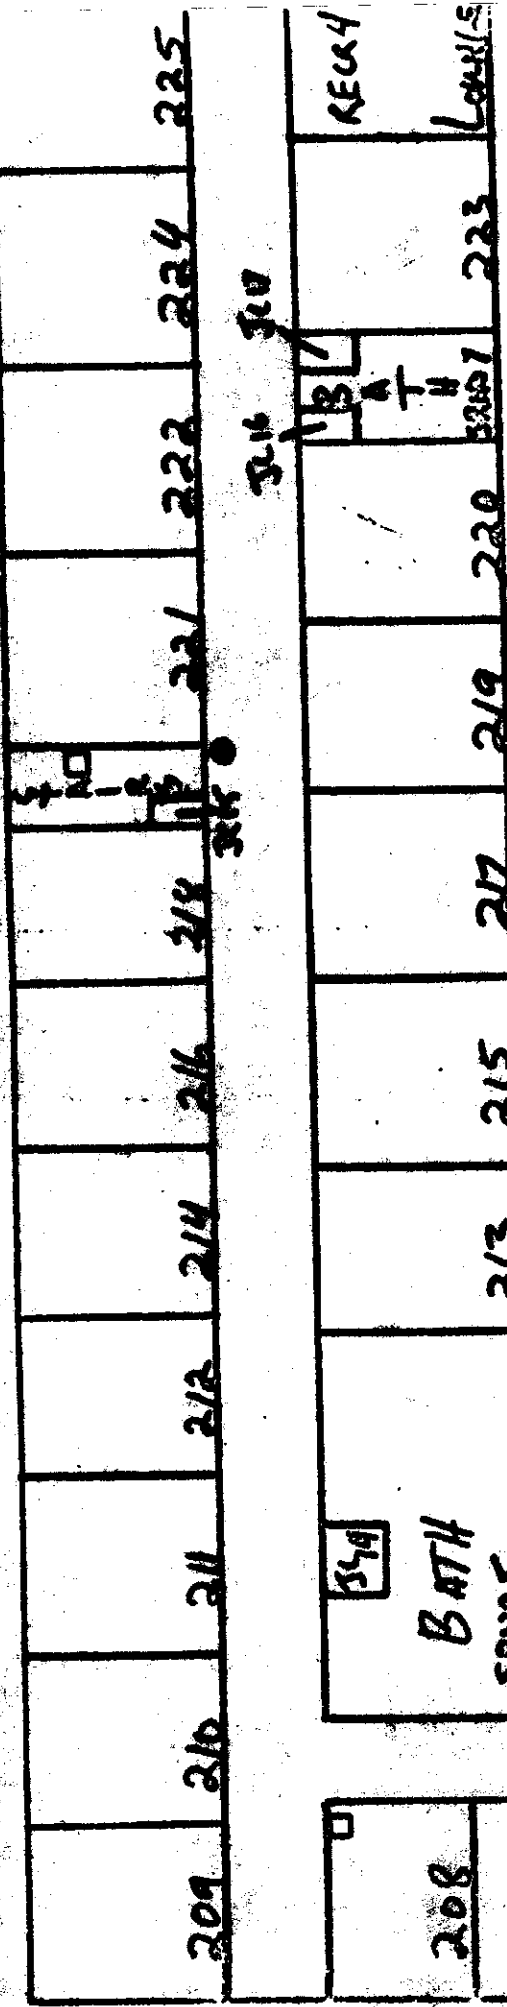


(N/D)

BOSTON SECOND FLOOR NORTH WING

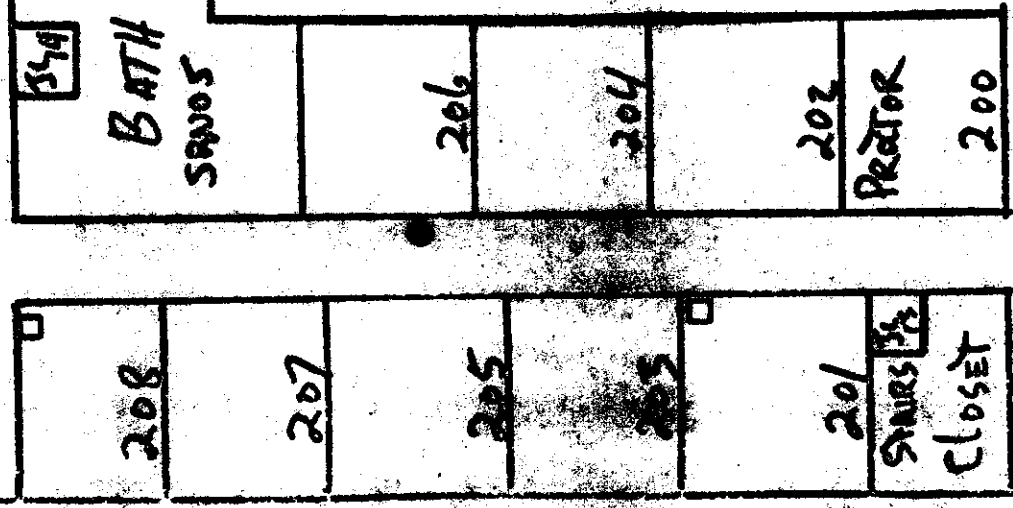

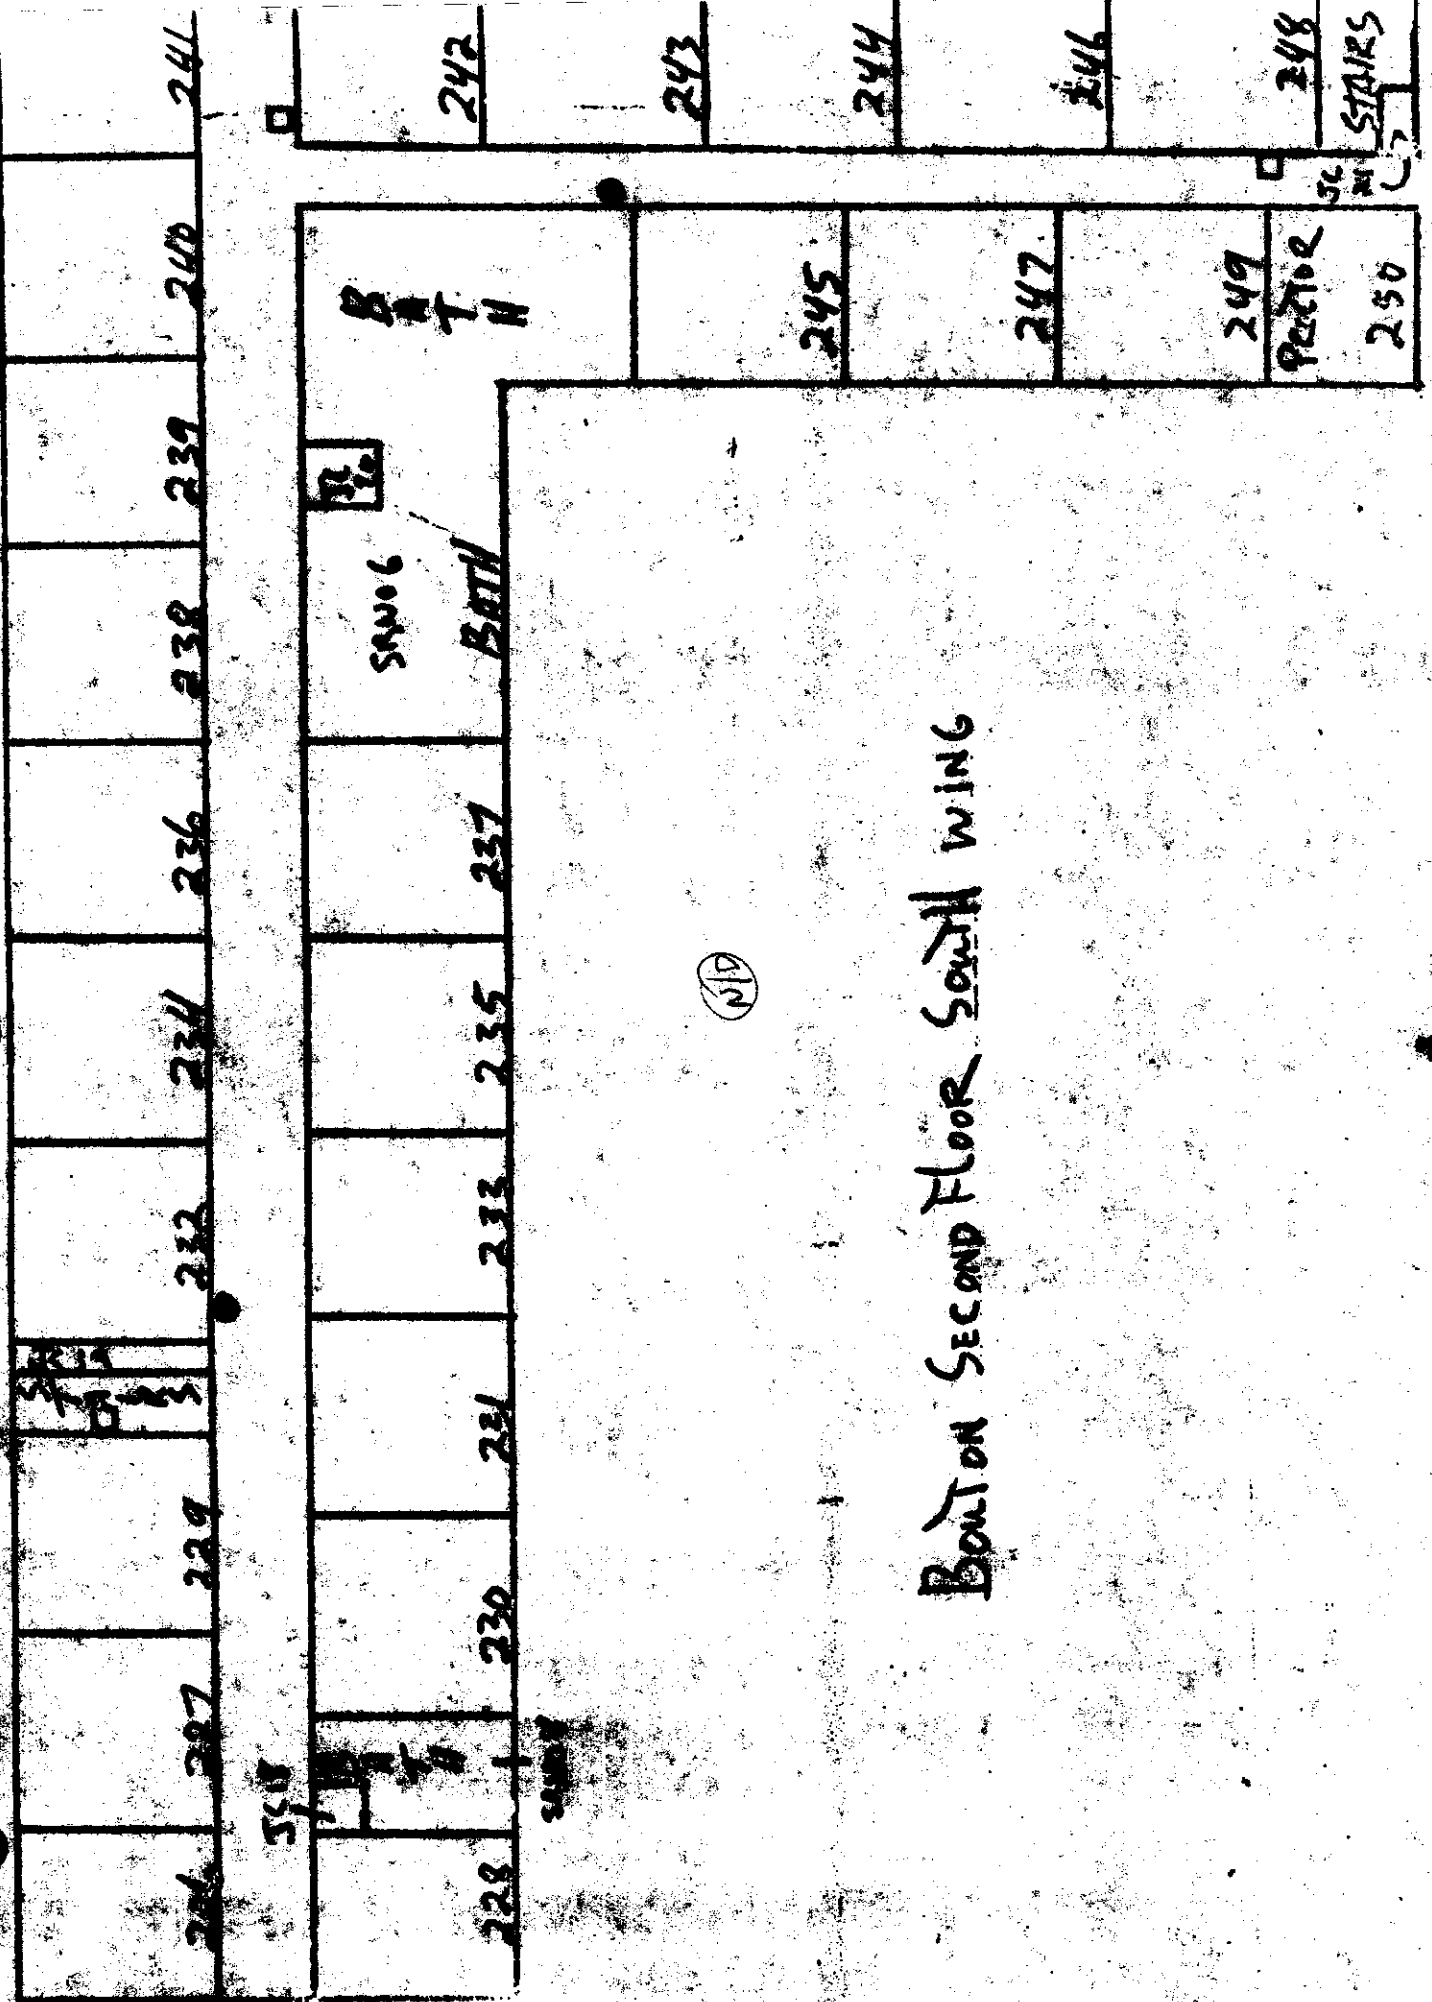

BOLTON SECOND FLOOR SOUTH WING

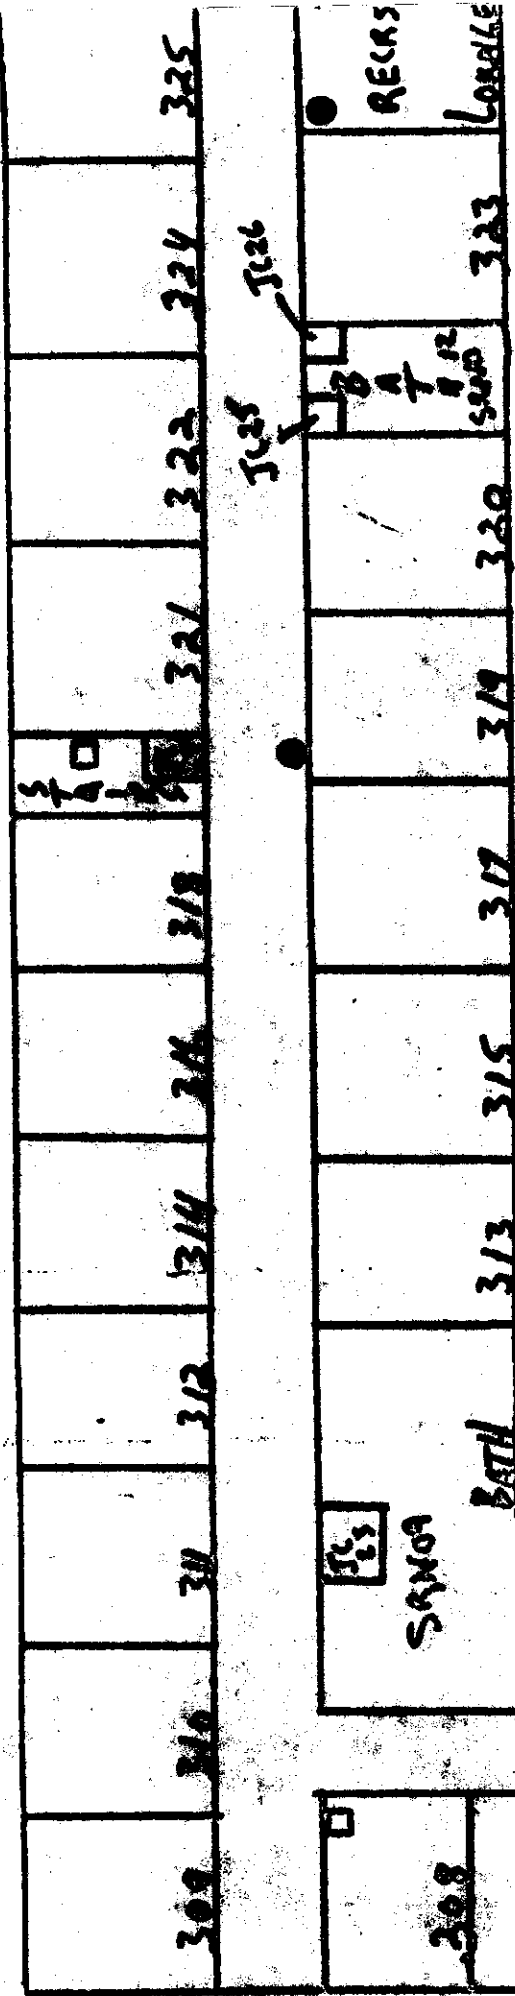


(ND)

Boston Third Floor North wing

12

13A


BOUTON HALL
LUGGAGE ROOM 2

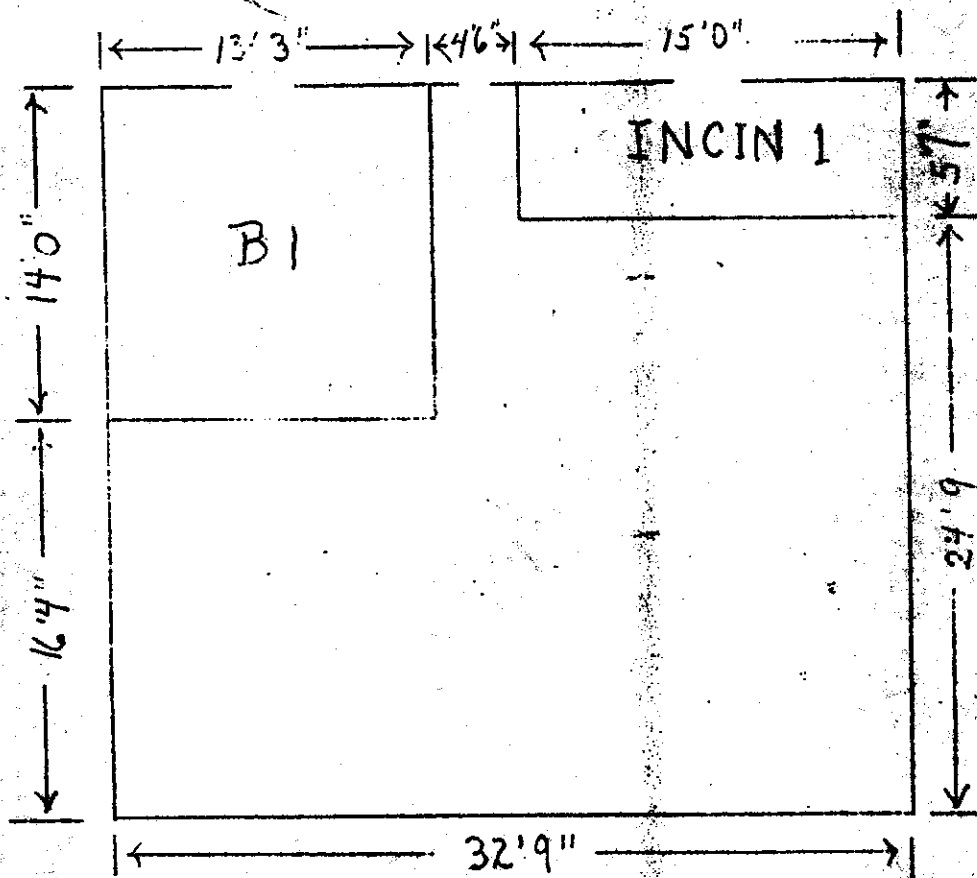

SCALE APPROX.

1" = 8'

BOLTON HALL DIRECTOR'S SUITE

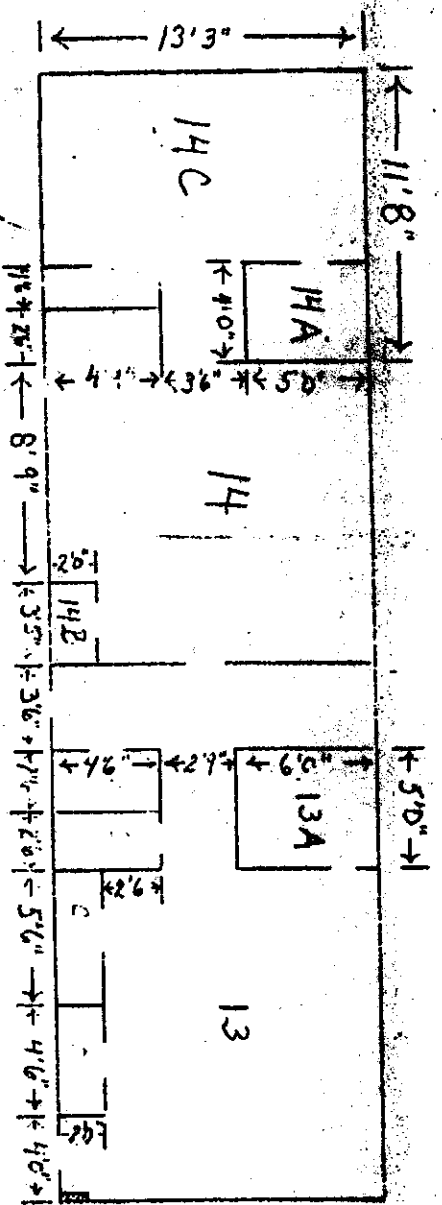

SCALE APPROX.

1" = 8'



Clean Harbors
ANALYTICAL SERVICES
325 WOOD ROAD, BRAINTREE, MA 02184
(617) 849-6070

REPORT OF ANALYSIS

Clean Harbors of Kingston, Inc.
New York Division
P.O. Box 1812
Albany, NY 12201

Project: SUNY - NEW PALTZ COLLEGE
P.O. #: A-8820

Date Received: 12/31/91
CHAS Lab #: 9112301

Attn: Mr. George Cebula

Enclosed are the results for the sample(s) delivered to our laboratory on the date indicated above.

The methods listed represent those methodologies which were used to develop the best analytical techniques. Analytical results and quality assurance protocols are based on these guidelines. These meet the requirements for the reporting of results under the RCRA, NPDES and Safe Drinking Water Act regulations.

Clean Harbors Analytical Services has an active program of quality assurance and quality control. The program closely follows the guidance provided in the EPA Contract Laboratory Program Statement of Work (organic and inorganic), the guidance provided in SW-846, and many other pertinent documents.

Should you have any questions concerning this work, please do not hesitate to contact me.

The information contained in this report is, to the best of my knowledge, accurate and complete.

Per/Date:  1/2/92

Robert E. Bentley
Laboratory Manager



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 1-1, BOSTON HALL
Sample Type: Wipe

CRAS Lab #: 9112901-01N
Date Received: 12/31/91

Polychlorinated Biphenyls (PCBs)

Extraction Date: 12/31/91
Analysis Date: 12/31/91

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.