


ELECTRICAL EQUIPMENT SAMPLES

LOCATION	ID #	DATE	TYPE	RESULTS	COMMENTS
BLISS	22A11692	01/16/92	WIPE	2.2 as 1260	ELECTRICAL BOX PANEL
BLISS	2261092-WALL B	06/10/92	WIPE	2.2 as 1260	ELECTRICAL ROOM WALL B JUNCTION BOX
BLISS	2232792-A1 (1 X 900) SQ cm	03/26/92	WIPE	1,700 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-A2 (1 X 900) SQ cm	03/26/92	WIPE	550 as 1260	ELECTRICAL BOXES OUTSIDE
BLISS	2232792-A3 (1 X 900) SQ cm	03/26/92	WIPE	46 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-A4 (1 X 900) SQ cm	03/26/92	WIPE	20 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-A5 (1 X 900) SQ cm	03/26/92	WIPE	23 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-B1 (1 X 900) SQ cm	03/26/92	WIPE	1.2 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-B2 (1 X 900) SQ cm	03/26/92	WIPE	ND as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-B3 (1 X 900) SQ cm	03/26/92	WIPE	36 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-B4 (1 X 900) SQ cm	03/26/92	WIPE	40 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-B6 (1 X 900) SQ cm	03/26/92	WIPE	140 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2232792-B7 (1 X 900) SQ cm	03/26/92	WIPE	18 as 1260	ELECTRICAL BOXES OUTSIDE
BLISS	22327920-C2 (1 X 900) SQcm	03/26/92	WIPE	12 as 1260	ELECTRICAL BOXES INSIDE
BLISS	22327920-C3 (1 X 900) SQcm	03/26/92	WIPE	45 as 1260	ELECTRICAL BOXES INSIDE
BLISS	22327920-C4 (1 X 900) SQ cm	03/26/92	WIPE	37 as 1260	ELECTRICAL BOXES INSIDE
BLISS	22327920-C5 (1 X 900) SQ cm	03/26/92	WIPE	58 as 1260	ELECTRICAL BOXES INSIDE
BLISS	22327920-C7 (1 X 900) SQ cm	03/26/92	WIPE	56 as 1260	ELECTRICAL BOXES OUTSIDE
BLISS	22327920-C8 (1 X 900) SQ cm	03/26/92	WIPE	100 as 1260	ELECTRICAL BOXES INSIDE
BLISS	22327920-C9 (1 X 900) SQ cm	03/26/92	WIPE	9.9 as 1260	ELECTRICAL BOXES INSIDE
BLISS	2271492-L3A-0 (1 @ (30 cm X 30 cm))	07/14/92	WIPE	0.3 as 1260	ELECTRICAL PANEL-OUTSIDE LEFT OF RM 307
BLISS	2271492-L3A-I (1 @ (30 cmX 30 cm))	07/14/92	WIPE	2.1 as 1260	ELECTRICAL PANEL-INSIDE LEFT OF RM 307

BLISS 2271492-L3B-O	07/14/92	WIPE	0.2 as 1260	ELECTRICAL PANEL-OUTSIDE
(1 @ (30 cm X 30 cm))				RIGHT OF RM 326
BLISS 2271492-L3B-I	07/14/92	WIPE	0.5 as 1260	ELECTRICAL PANEL-INSIDE
(1 @ (30 cm X 30 cm))				RIGHT OF RM 326
BLISS 2271092L1BI	07/10/92	WIPE	2.2 as 1260	L1B ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092L1BO	07/10/92	WIPE	0.3 as 1260	L1B ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092PLAI	07/10/92	WIPE	0.9 s 1260	PLA ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092PLAO	07/10/92	WIPE	0.1 as 1260	PLA ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092PLBGI	07/10/92	WIPE	3.5 as 1260	PLBG ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092PLBGO	07/10/92	WIPE	0.4 as 1260	PLBG ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092L2BI	07/10/92	WIPE	11 as 1260	L2B ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092L2BO	07/10/92	WIPE	0.4 as 1260	L2B ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092L2AI	07/10/92	WIPE	4.3 as 1260	L2A ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092L2AO	07/10/92	WIPE	0.3 as 1260	L2A ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092LBAI	07/10/92	WIPE	5.1 as 1260	LBA ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092LBAO	07/10/92	WIPE	0.5 as 1260	LBA ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092L1AI	07/10/92	WIPE	1.6 as 1260	L1A ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092L1AO	07/10/92	WIPE	ND	L1A ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE
BLISS 2271092LBBI	07/10/92	WIPE	8.8 as 1260	LBB ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				INSIDE
BLISS 2271092LBBO	07/10/92	WIPE	1.1 as 1260	LBB ELECTRICAL PANEL
(1 @ (30 cm X 30 cm))				OUTSIDE

BLISS HALL ELECTRICAL ROOM EQUIPMENT


(WALL "A")

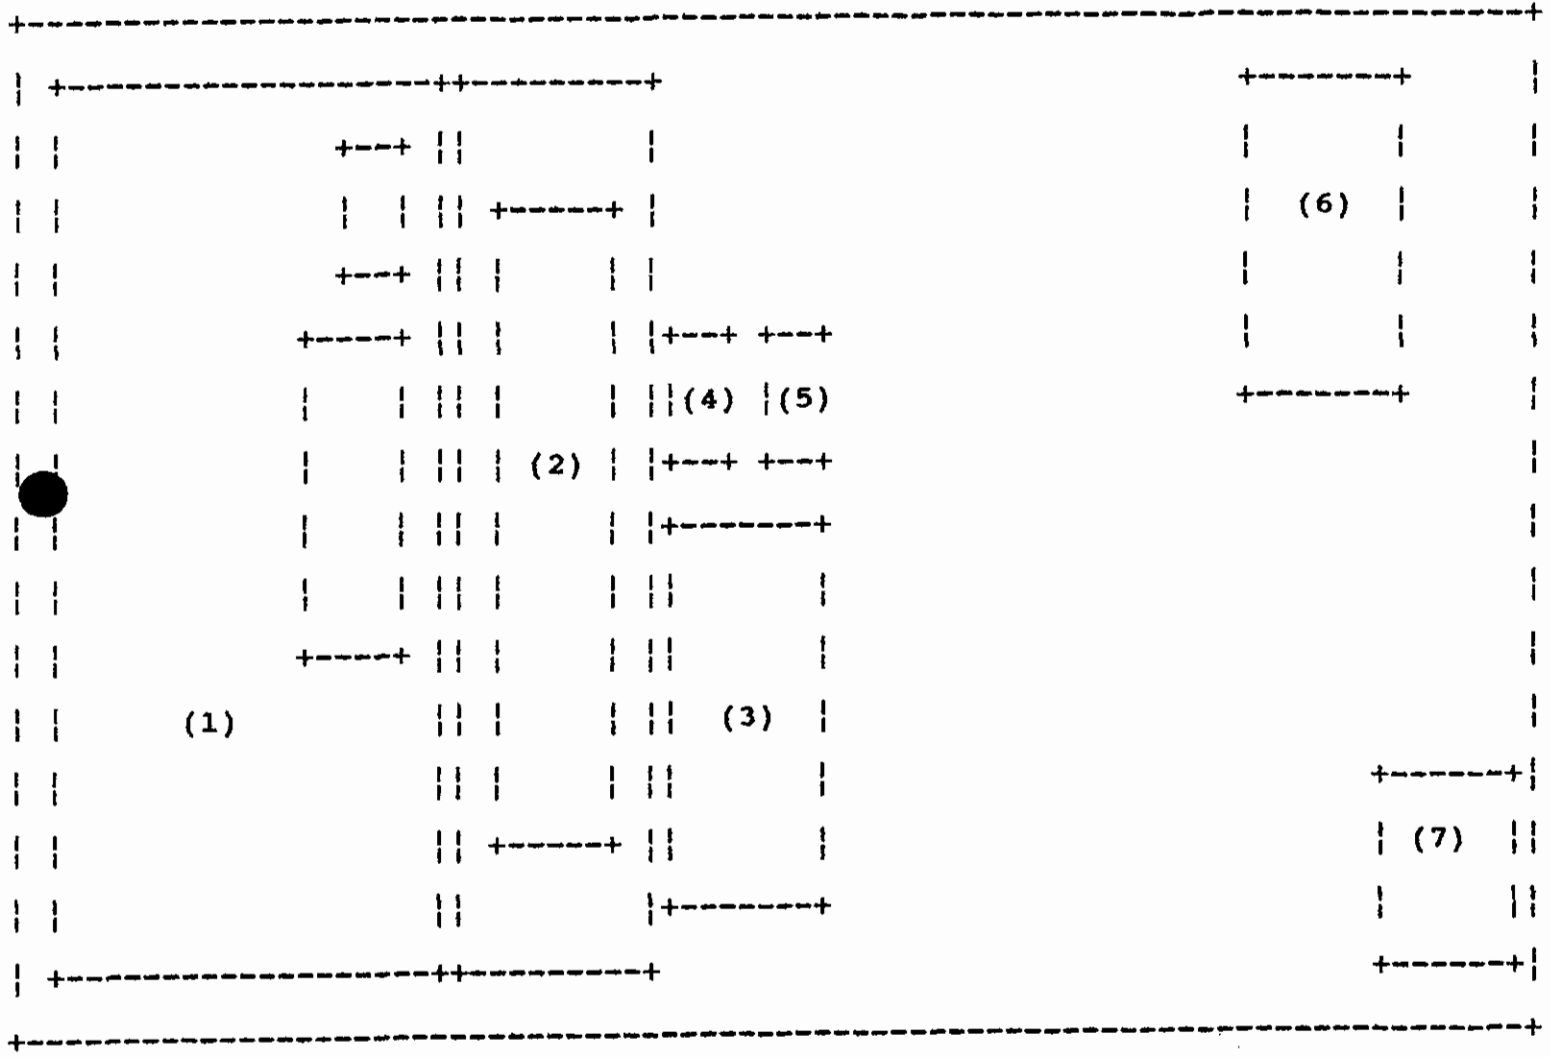

NOTE: NOT TO SCALE

BLISS ELECTRICAL ROOM EQUIPMENT


(WALL "B")

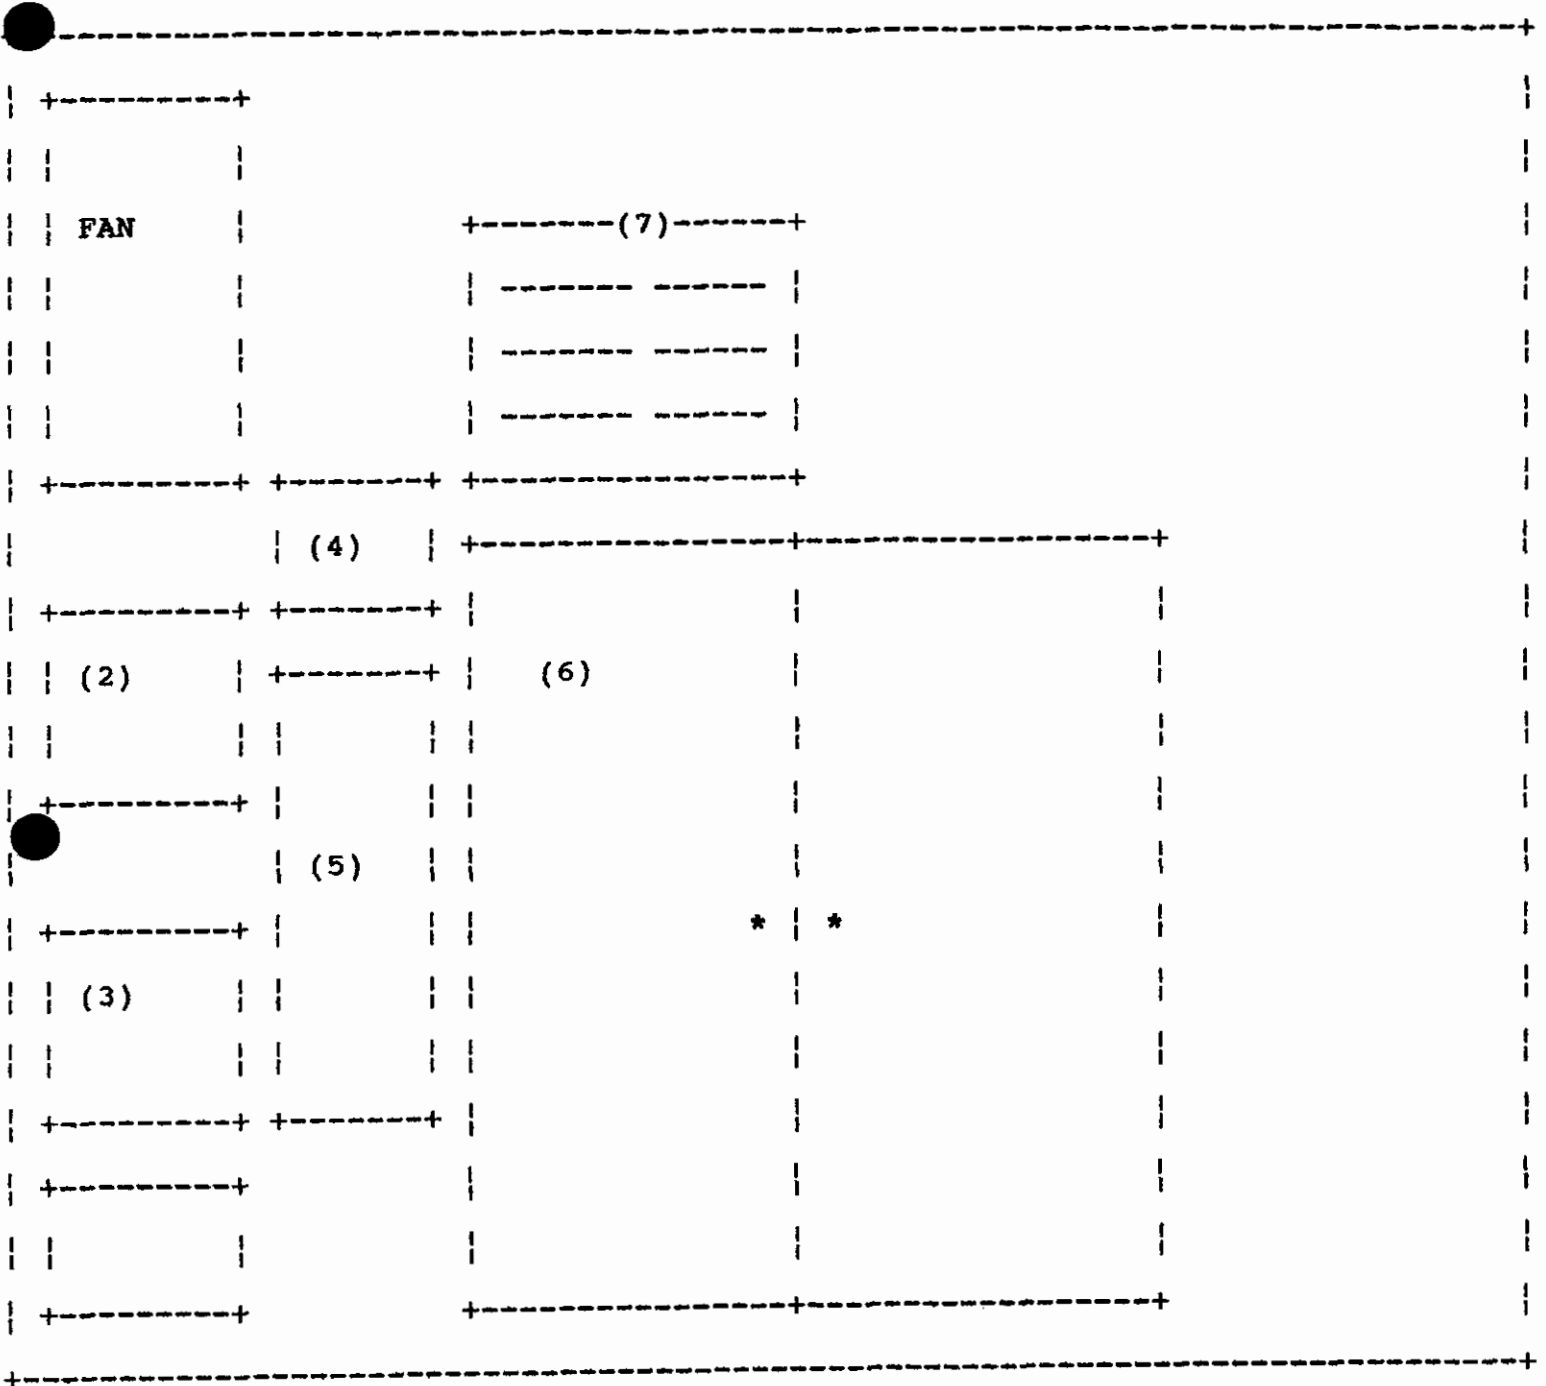

NOTE: NOT TO SCALE

BLISS ELECTRICAL ROOM EQUIPMENT

(WALL "C")

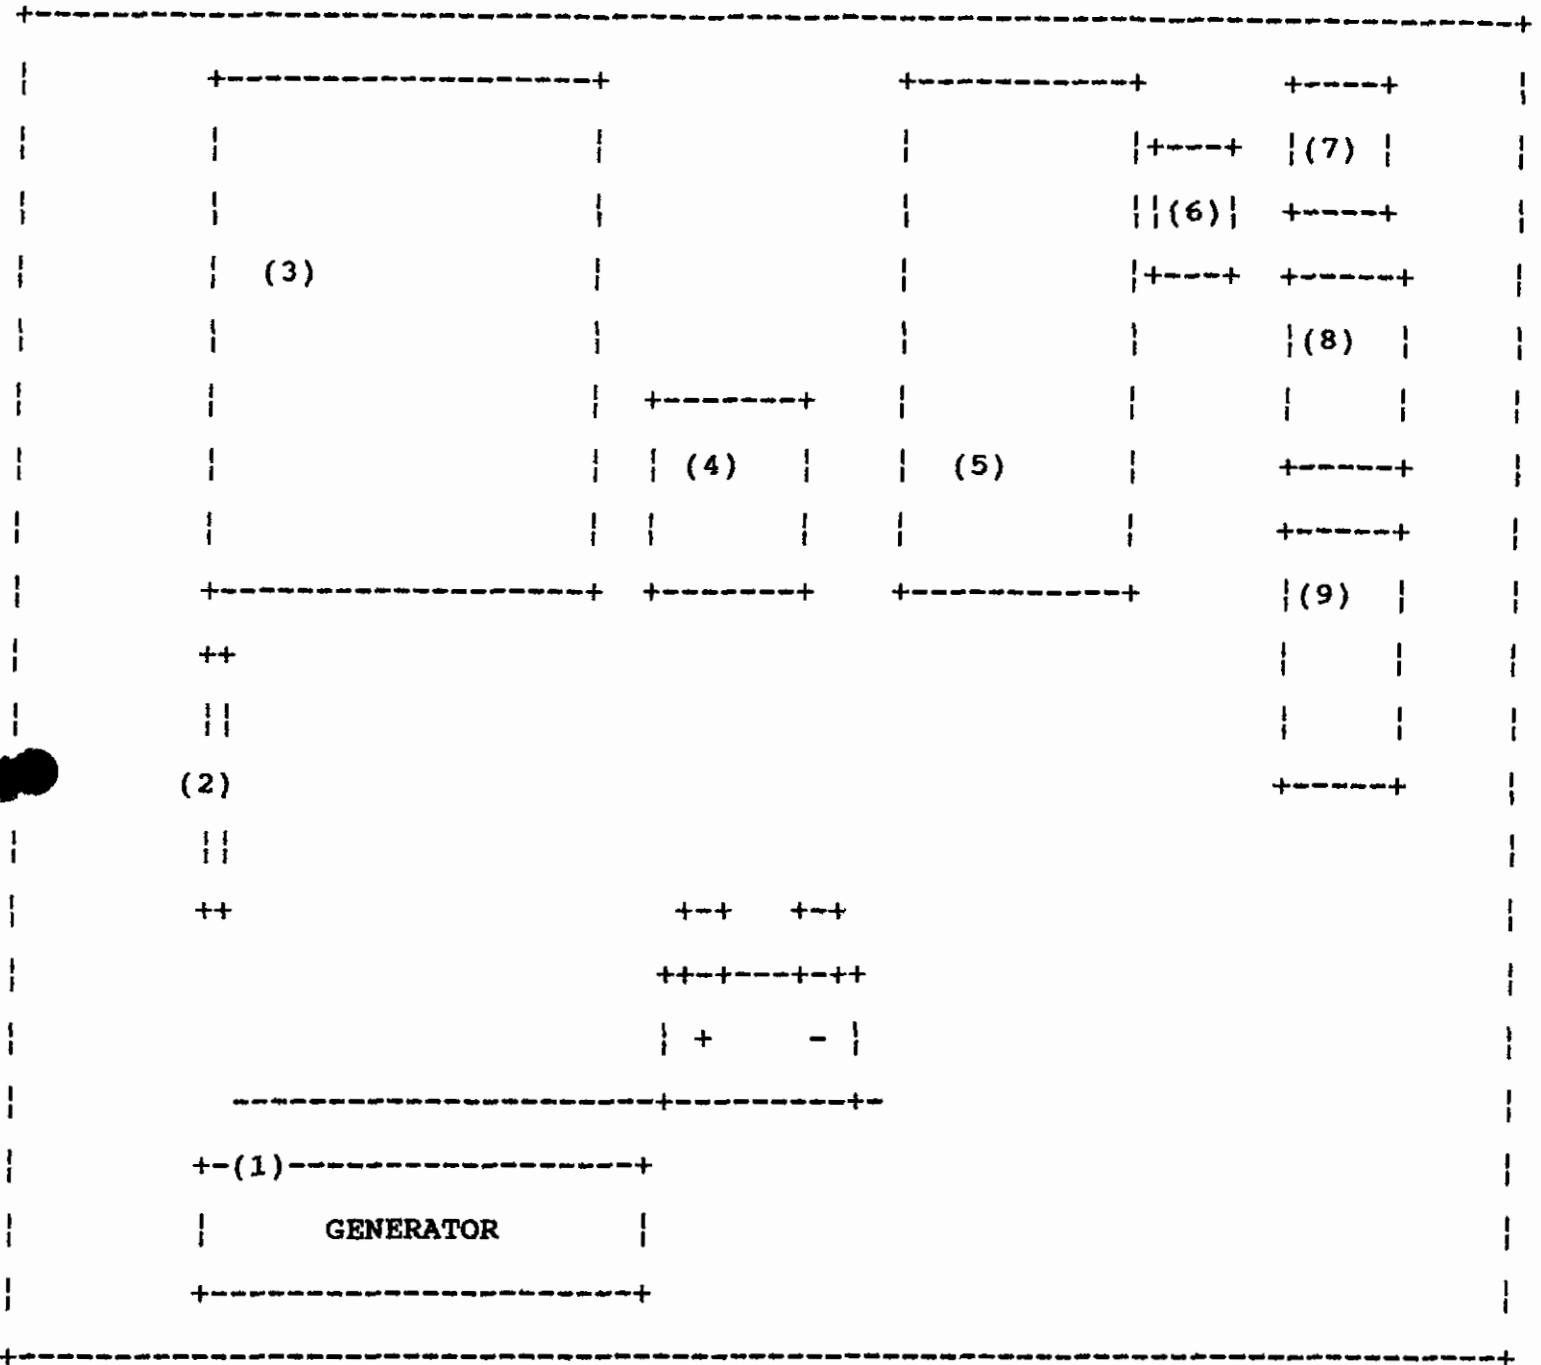

NOTE: NOT TO SCALE



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 22A11692 BLISS HALL
Sample Type: Wipe

CHAS Lab #: 9201176-02
Date Received: 01/17/9

Polychlorinated Biphenyls (PCBs)

Extraction Date: 01/17/92
Analysis Date: 01/17/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	2.2	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2261092-WALL B BLISS
Sample Type: Wipe

CHAS Lab #: 9206171-01N
Date Received: 06/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/11/92
Analysis Date: 06/11/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	2.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-A1 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-01N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/07/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	100	ND	ug/100 sq cm
PCB - Aroclor 1221	100	ND	ug/100 sq cm
PCB - Aroclor 1232	100	ND	ug/100 sq cm
PCB - Aroclor 1242	100	ND	ug/100 sq cm
PCB - Aroclor 1248	100	ND	ug/100 sq cm
PCB - Aroclor 1254	100	ND	ug/100 sq cm
PCB - Aroclor 1260	100	1,700	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-A2 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-02N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	550	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-A3 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-03N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	46	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-A4 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-04N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	20	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-A5 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-05N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	23	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-B1 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-06N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.2	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-B2 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-07N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-B3 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-08N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	36	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-B4 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-09N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	40	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-B6 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-10N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	140	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-B7 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-11N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	18	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C2 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-12N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	12	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C3 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-13N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	45	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C4 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-14N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	37	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C5 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-15N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92
Analysis Date: 04/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	58	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C7 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-16N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92

Analysis Date: 04/07/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	56	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C8 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-17N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92

Analysis Date: 04/07/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	100	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2232792-C9 BLISS
Sample Type: Wipe

CHAS Lab #: 9203467-18N
Date Received: 03/31/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 04/02/92

Analysis Date: 04/07/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	9.9	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271492 L3A-O BLISS
Sample Type: Wipe

CHAS Lab #: 9207159-01N
Date Received: 07/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/16/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271492 L3A-I BLISS
Sample Type: Wipe

CHAS Lab #: 9207159-02N
Date Received: 07/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/16/92

Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	2.1	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271492 L3B-O BLISS
Sample Type: Wipe

CHAS Lab #: 9207159-03N
Date Received: 07/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/16/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271492 L3B-I BLISS
Sample Type: Wipe

CHAS Lab #: 9207159-04N
Date Received: 07/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/16/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.5	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092L1BI BLISS
Sample Type: Wipe

CHAS Lab #: 9207123-01N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	2.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092L1B0 BLISS
Sample Type: Wipe

CHAS Lab #: 9207123-02N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92

Analysis Date: 07/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092PLAI BLISS
Sample Type: Wipe

CHAS Lab #: 9207123-03N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.9	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092PLAO BLISS
Sample Type: Wipe

CHAS Lab #: 9207123-04N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.1	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092PLBGI BLISS
Sample Type: Wipe

CHAS Lab #: 9207123-05N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	3.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092PLBGO BLISS
Sample Type: Wipe

CHAS Lab #: 9207123-06N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.4	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092L2BI BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-01N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/22/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	11	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092L2BO BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-02N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.4	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092L2AI BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-03N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	4.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092L2AO BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-04N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092LBAI BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-05N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	5.1	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092LBAO BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-06N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/16/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092LLAI BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-07N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.6	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092LLAO BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-08N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092LBBI BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-09N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/22/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	8.8	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2271092LBBO BLISS
Sample Type: Wipe

CHAS Lab #: 9207122-10N
Date Received: 07/11/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/14/92
Analysis Date: 07/22/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.1	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.