

ELECTRICAL ROOM

LOCATION	ID #	DATE	TYPE	RESULT	COMMENTS
WALL	21A11692	01/16/92	WIPE	17.0 as 1260	INSIDE ELECTRICAL PANEL COVER
GAGE	2152892-ELRM110 (1 @ 900 sq cm)	05/28/92	WIPE	5.0 as 1260	BACK OF COVERS ON 110 V OUTLETS, NORTH WALL
GAGE	2152892-ELRMWALL (1 @ 900 sq cm)	05/28/92	WIPE	6.4 as 1260	ELECTRICAL ROOM
GAGE	2172292-NORTH (1 @ 900 sq cm)	07/22/92	WIPE	0.2 as 1260	BASE OF BRICK WALL, SOUTH NORTH WALL OF ELECTRICAL ROOM POST CLEAN
GAGE	2172292-SOUTH (1 @ 900 sq cm)	07/22/92	WIPE	0.2 as 1260	SOUTH WALL OF ELECTRICAL ROOM POST CLEAN
GAGE	2172292-EAST (1 @ 900 sq cm)	07/22/92	WIPE	0.2 as 1260	EAST WALL OF ELECTRICAL ROOM POST CLEAN
GAGE	2172292-WEST (1 @ 900 sq cm)	07/22/92	WIPE	0.1 as 1260	WEST WALL OF ELECTRICAL ROOM POST CLEAN
GAGE	2172292-NORTHFL (1 @ 900 sq cm)	07/22/92	WIPE	15 as 1260	FLOOR-NORTH END POST CLEAN
GAGE	2172292-SOUTHFL (1 @ 900 sq cm)	07/22/92	WIPE	41 as 1260	FLOOR-SOUTH END POST CLEAN
GAGE	2172292-WESTFL (1 @ 900 sq cm)	07/22/92	WIPE	13 as 1260	FLOOR-WEST END POST CLEAN
GAGE	2172292-EASTFL (1 @ 900 sq cm)	07/22/92	WIPE	41 as 1260	FLOOR-EAST END POST CLEAN
GAGE	2172892-ERFLR (9 @ (10 cm X 10 cm))	07/28/92	WIPE	39 as 1260	ELECTRIC ROOM FLOOR SCARIFIED
(NOTE: ELECTRICAL ROOM FLOOR AND VAULT FLOOR WERE REMOVED AFTER THESE SAMPLES WERE TAKEN)					
GAGE	2142992-A1 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	4900 as 1260	INSIDE OF SWITCH BOX
GAGE	2142992-A2 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	480 as 1260	INSIDE OF FUSEBOX
GAGE	2142992-A3 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	4.1 as 1260	INSIDE OF BREAKER PANEL
GAGE	2142992-A4 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	160 as 1260	INSIDE OF FUSE BOX
GAGE	2142992-A5 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	100 as 1260	INSIDE OF FUSE BOX
GAGE	2142992-A6 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	550 as 1260	INSIDE OF WATCHDOG BOX
GAGE	2142992-A7	04/29/92	WIPE	1,100 as 1260	INSIDE SWITCH BOX (BOX A7)
GAGE	2142992-A8	04/29/92	WIPE	200 as 1260	INSIDE TERMINAL SWITCH BOX (BOX A8)
GAGE	2142992-B1	04/29/92	WIPE	2.2 as 1260	INSIDE WIRE CONNECTION BOX (BOX B1)
GAGE	2142992-D1 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	11 as 1260	INSIDE OF SWITCH BOX
GAGE	2142992-D2 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	15 as 1260	INSIDE OF BATTERY CHARGER BOX
GAGE	2142992-D3 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	67 as 1260	INSIDE OF SWITCH BOX
GAGE	2142992-D4 (1 @ (30 cm X 30 cm))	04/29/92	WIPE	25 as 1260	INSIDE OF BATTERY CHARGER BOX
GAGE	216492-PC1 (1 @ 900 sq cm)	06/04/92	WIPE	1.4 as 1260	CIRCUIT PANEL PC1 MECHANICAL ROOM

GAGE 2161292-PC1 (1 @ 900 sq cm)	06/12/92	WIPE 0.3 as 1260	CIRCUIT BREAKER PANEL PC-1 IN MECHANICAL ROOM
GAGE 216492-HWHSWITCH (1 @ 900 sq cm)	06/04/92	WIPE 1.8 as 1260	BASEMENT MECHANICAL ROOM HOT WATER HEATER SWITCH BM-6-P
GAGE 2161292-HWH (1 @ 900 sq cm)	06/12/92	WIPE 0.6 as 1260	HOT WATER HEATER IN ROOM BM-6
GAGE 2152992-PA (1 @ 900 sq cm)	05/29/92	WIPE 6.0 as 1260	BASEMENT HALL-PANEL PA PRE-CLEAN
GAGE 216492-PA (1 @ 900 sq cm)	06/04/92	WIPE 0.5 as 1260	BASEMENT HALL PANEL PA-POST CLEAN
GAGE 2152992-P-B (1 @ 900 sq cm)	05/29/92	WIPE 5.2 as 1260	BASEMENT HALL-PANEL P-B PRE-CLEAN
GAGE 216492-PB (1 @ 900 sq cm)	06/04/92	WIPE 0.4 as 1260	BASEMENT HALL PANEL PB-POST CLEAN
GAGE 2152992-PC-12 (1 @ 900 sq cm)	05/29/92	WIPE 2.5 as 1260	BASEMENT MECHANICAL ROOM PANEL PC-1,2
GAGE 216492-PC2/JUNCTION (1 @ 900 sq cm)	06/04/92	WIPE 0.6 as 1260	CIRCUIT BREAKER PANEL P12 AND JUNCTION BOX BENEATH
GAGE 2152992-LB-A (1 @ 900 sq cm)	05/29/92	WIPE 1.5 as 1260	BASEMENT HALL-PANEL LB-A
GAGE 216492-LB-A (1 @ 900 sq cm)	06/04/92	WIPE 0.3 as 1260	BASEMENT HALL PANEL LB-A/POST CLEAN
GAGE 2152992-LB-B (1 @ 900 sq cm)	05/29/92	WIPE 4.6 as 1260	BASEMENT HALL-PANEL LB-B PRE-CLEAN
GAGE 216492-LB-B (1 @ 900 sq cm)	06/04/92	WIPE 0.3 as 1260	BASEMENT HALL PANEL LB-B - POST CLEAN
GAGE 2152992-L1-A (1 @ 900 sq cm)	05/29/92	WIPE 1.5 as 1260	FIRST FLOOR HALL PANEL L1-A/PRE-CLEAN
GAGE 216492-L1-A (1 @ 900 sq cm)	06/04/92	WIPE 0.2 as 1260	FIRST FLOOR HALL PANEL L1-A/POST CLEAN
GAGE 2152992-L1-B (1 @ 900 sq cm)	05/29/92	WIPE 0.9 as 1260	FIRST FLOOR HALL PANEL L1-B
GAGE 2152992-2-A (1 @ 900 sq cm)	05/29/92	WIPE 1.9 as 1260	SECOND FLOOR HALL PANEL 2-A/PRE-CLEAN
GAGE 216492-2-A (1 @ 900 sq cm)	06/04/92	WIPE 0.4 as 1260	SECOND FLOOR HALL PANEL 2-A/POST CLEAN
GAGE 2152992-2-B (1 @ 900 sq cm)	05/29/92	WIPE 0.6 as 1260	SECOND FLOOR HALL PANEL 2-B
GAGE 2152992-3-A (1 @ 900 sq cm)	05/29/92	WIPE 0.3 as 1260	THIRD FLOOR HALL PANEL 3-A
GAGE 2152992-3-B (1 @ 900 sq cm)	05/29/92	WIPE 0.5 as 1260	THIRD FLOOR HALL PANEL 3-B
GAGE PANEL-BM-3 (1 @ 900 sq cm)	06/12/92	WIPE 0.5 as 1260	LIGHT PANEL FOR OUTDOOR LIGHTS; ROOM BM-3
GAGE 212892-CB (1 @ 100 sq cm)	07/28/92	WIPE 1.8 as 1260	FIRE ALARM CIRCUIT BOARD 1ST POST CLEAN
GAGE 213892CB (1 @ 900 sq cm)	08/03/92	WIPE ND	FIRE ALARM CIRCUIT BOARD 2ND POST CLEAN

DRUM 217992-W1
STORAGE
DRUM 217992-W2
STORAGE
DRUM 217992-W3
STORAGE
DRUM 217992-W4
STORAGE


07/09/92	WIPE 0.6 as 1260	WHEEL OF CABLE #1 - FROM GAGE TEMP. TRANS. ROOM
07/09/92	WIPE 0.3 as 1260	WHEEL OF CABLE #2 - FROM GAGE TEMP. TRANS. ROOM
07/09/92	WIPE 0.7 as 1260	WHEEL OF CABLE #3 - FROM GAGE TEMP. TRANS. ROOM
07/09/92	WIPE 1.1 as 1260	WHEEL OF CABLE #4 - FROM GAGE TEMP. TRANS. ROOM

GAGE 2172092-1
GAGE 2172092-2
GAGE 2172092-3
GAGE 2172092-4
GAGE 2172092-5
GAGE 2172092-6
GAGE 2172092-7
GAGE 2172092-8

07/20/92	WIPE 0.3 as 1260	WIRE COIL #1
07/20/92	WIPE ND	WIRE COIL #2
07/20/92	WIPE ND	WIRE COIL #3
07/20/92	WIPE ND	WIRE COIL #4
07/20/92	WIPE ND	WIRE COIL #5
07/20/92	WIPE ND	WIRE COIL #6
07/20/92	WIPE ND	WIRE COIL #7
07/20/92	WIPE 0.2 as 1260	WIRE COIL #8

VIEW

(PATTERN)

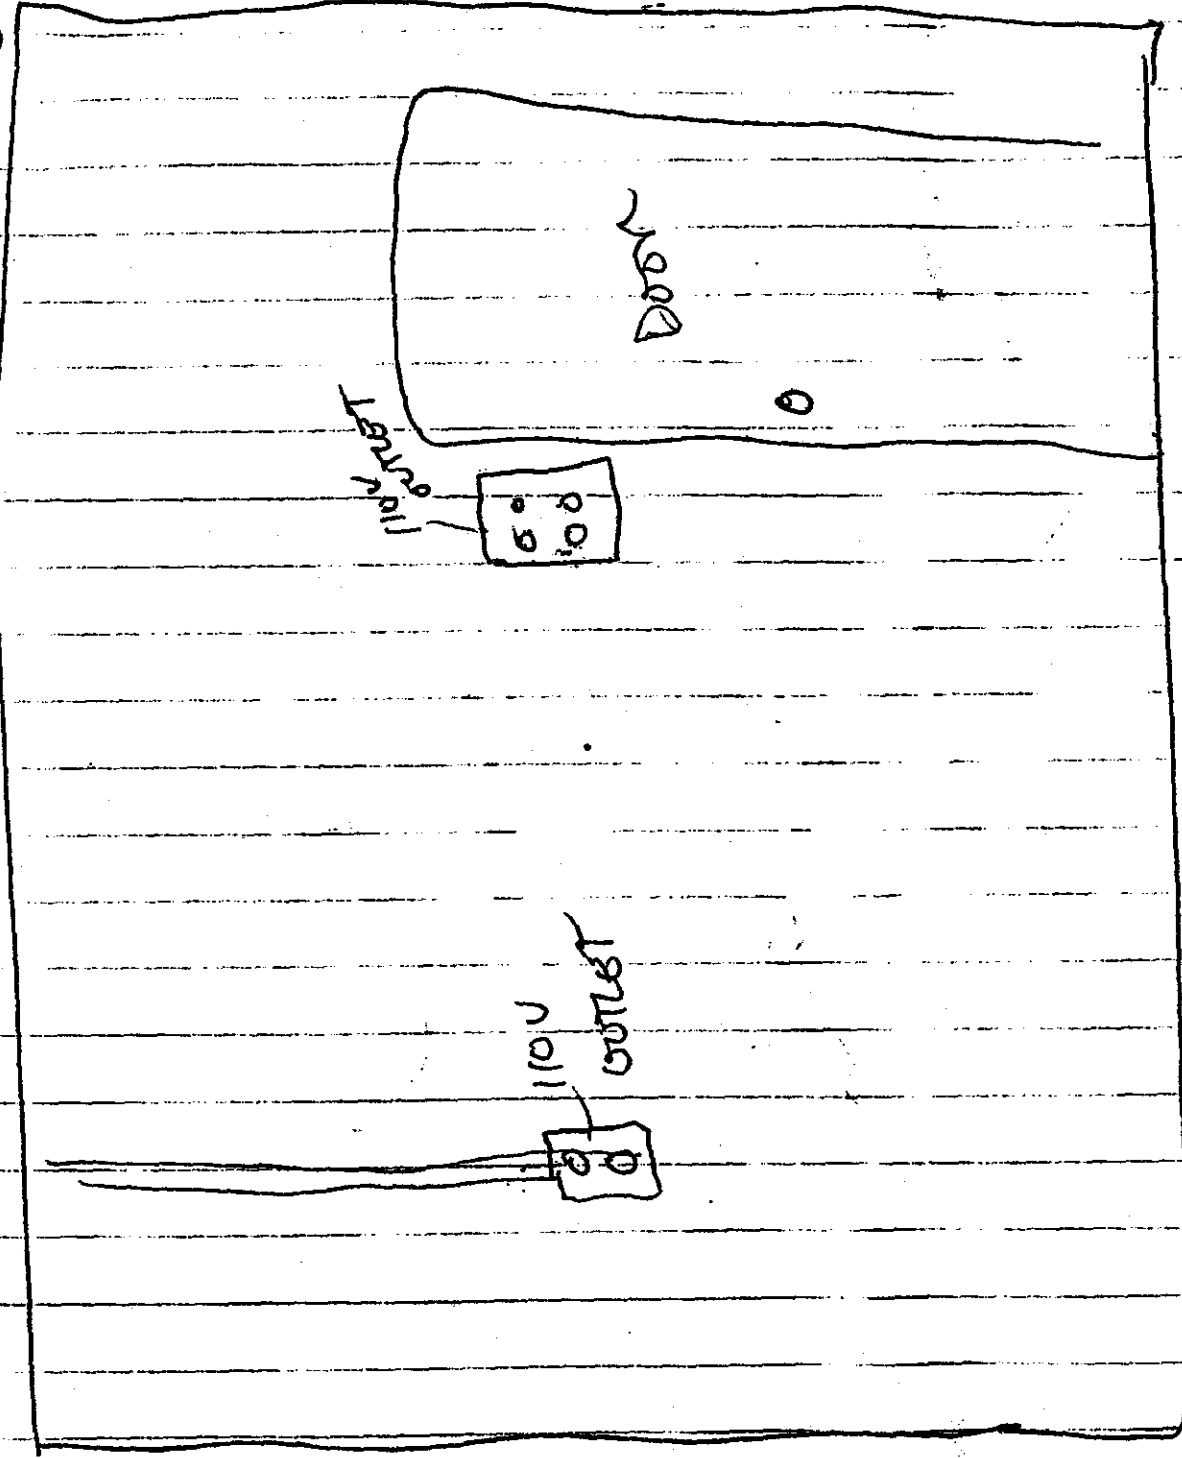


ELECTRICAL ROOM

GAGE

W.F. D


(EAST)

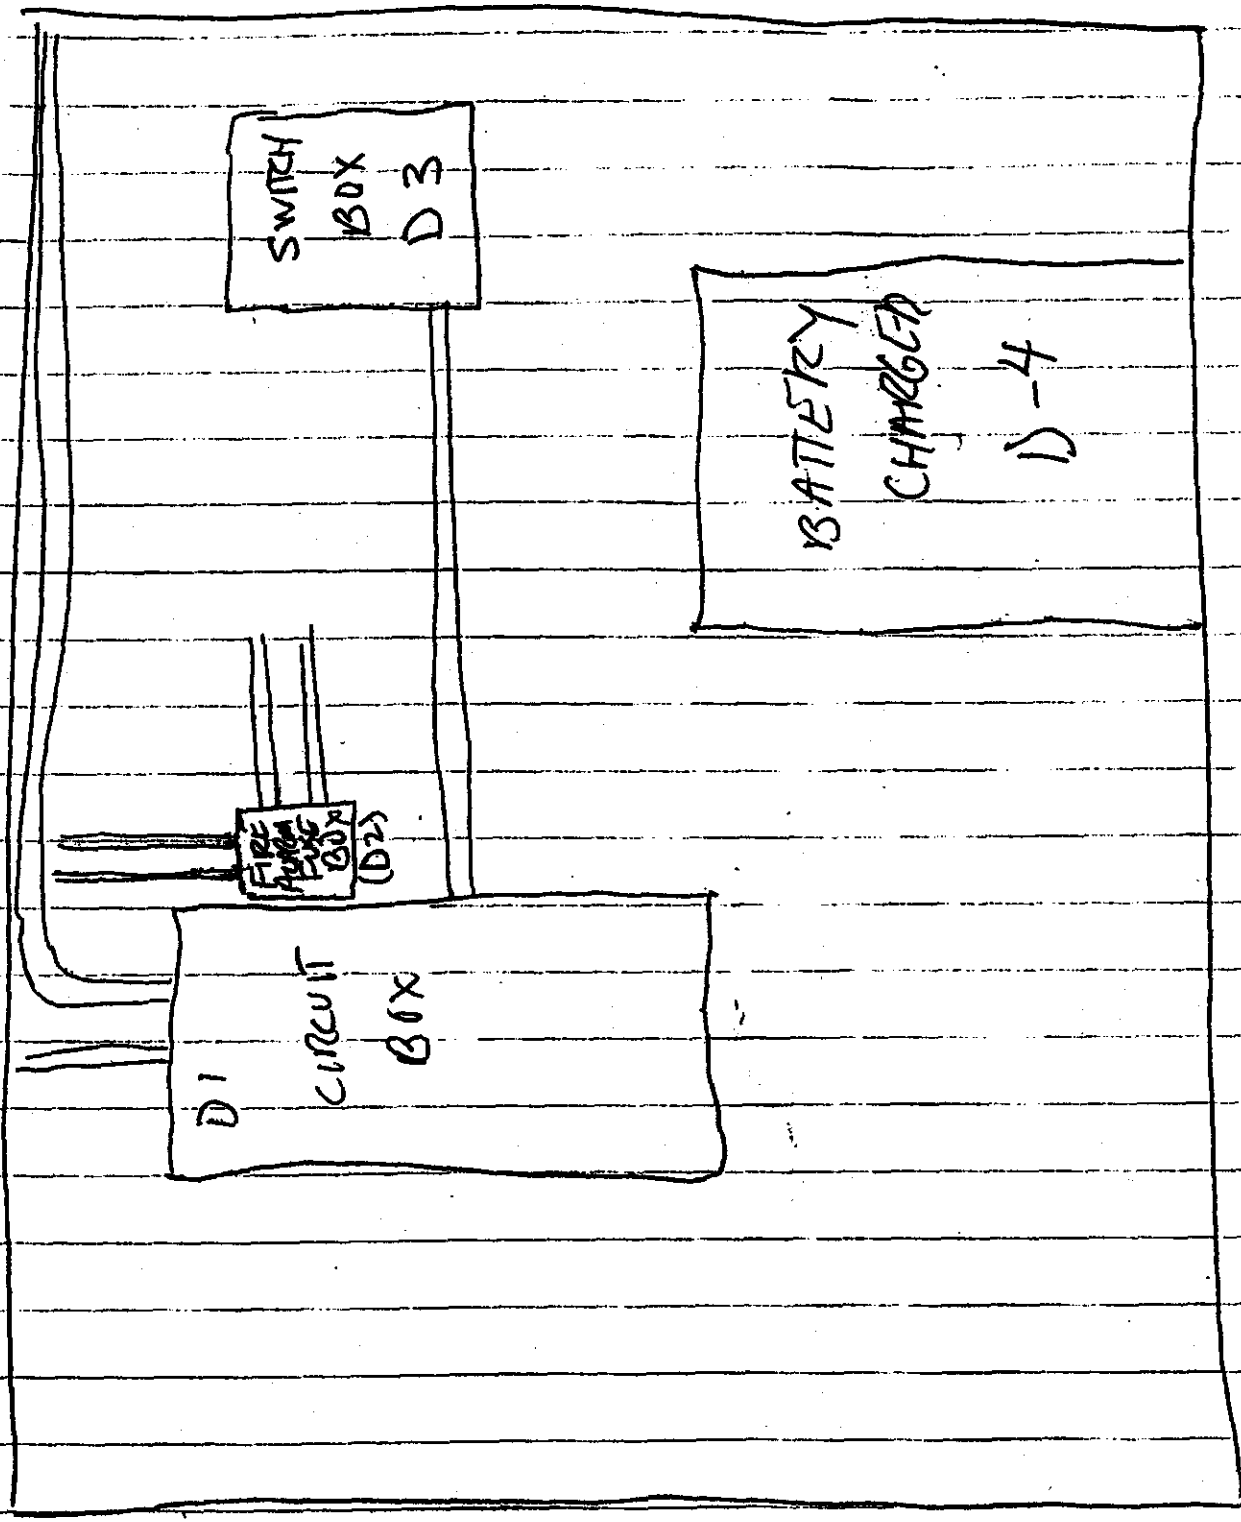

GAGE - ELECTRICAL ROOM

11
(SOUTH)

SWITCH
BOX
A-1

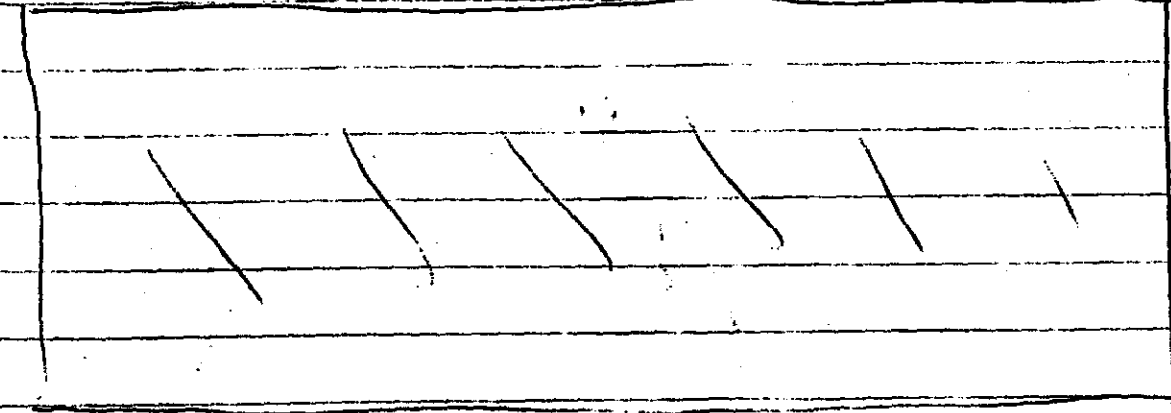

SWITCH
BOX
A-2

BREAKER
PANEL
A-3

SWITCH
BOX
A-4

FUSE
BOX
A-5

WATCHING
BOX
A-6

SHUNT
SWITCH
BOX
A-7

TERMINAL
SWITCH
BOX
A-8

GAGE - ELECTRICIAN ROOM

(WEST)

B

WIRE CONNECTION

BOX

B-1

GAGE ELECTRIC FORM



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 21A11692 GAGE HALL
Sample Type: Wipe

CHAS Lab #: 9201176-05N
Date Received: 01/17/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 01/17/92
Analysis Date: 01/17/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	17	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152892-ELRM110, GAGE
Sample Type: Wipe

CHAS Lab #: 9205308-03N
Date Received: 05/29/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/29/92
Analysis Date: 05/29/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	5.0	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152892-ELRM WALL, GAGE
Sample Type: Wipe

CHAS Lab #: 9205308-04N
Date Received: 05/29/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/29/92
Analysis Date: 05/29/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	6.4	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-NORTH GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-01N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92

Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-SOUTH GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-02N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92
Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-EAST GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-03N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92

Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-WEST GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-04N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92
Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.1	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-NORTHFL GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-05N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92
Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	15	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-SOUTHFL GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-06N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92
Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	41	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-WESTFL GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-08N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92
Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	13	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172292-EASTFL GAGE
Sample Type: Wipe

CHAS Lab #: 9207282-07N
Date Received: 07/23/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/23/92
Analysis Date: 07/24/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	41	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172892-ERFLR, GAGE
Sample Type: Wipe

CHAS Lab #: 9207359-04N
Date Received: 07/29/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/29/92
Analysis Date: 07/29/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	39	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A4 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-04N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/13/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	160	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A3 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-03N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/13/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	4.1	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A2 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-02N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/13/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	480	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A5 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-05N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/14/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	100	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A6 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-06N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/14/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	550	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A7 GAGE
Sample Type: Wipe

CHAS Lab #: 9204468-01N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/07/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	100	ND	ug/100 sq cm
PCB - Aroclor 1221	100	ND	ug/100 sq cm
PCB - Aroclor 1232	100	ND	ug/100 sq cm
PCB - Aroclor 1242	100	ND	ug/100 sq cm
PCB - Aroclor 1248	100	ND	ug/100 sq cm
PCB - Aroclor 1254	100	ND	ug/100 sq cm
PCB - Aroclor 1260	100	1,100	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-A8 GAGE
Sample Type: Wipe

CHAS Lab #: 9204468-02N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/06/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	10	ND	ug/100 sq cm
PCB - Aroclor 1221	10	ND	ug/100 sq cm
PCB - Aroclor 1232	10	ND	ug/100 sq cm
PCB - Aroclor 1242	10	ND	ug/100 sq cm
PCB - Aroclor 1248	10	ND	ug/100 sq cm
PCB - Aroclor 1254	10	ND	ug/100 sq cm
PCB - Aroclor 1260	10	200	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-B1 GAGE
Sample Type: Wipe

CHAS Lab #: 9204468-03N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/07/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	2.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-D1 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-07N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/14/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	11	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-2-A, GAGE
Sample Type: Wipe

CHAS Lab #: 9205311-02N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.9	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-2-A , GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-08N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.4	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-2-B, GAGE
Sample Type: Wipe

CHAS Lab #: 9205311-01N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.6	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-3-A, GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-08N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/02/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-3-B, GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-09N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/02/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2161292-PANEL-BM-3 GAGE
Sample Type: Wipe

CHAS Lab #: 9206208-03N
Date Received: 06/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/15/92
Analysis Date: 06/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 212892-CB GAGE
Sample Type: Wipe

CHAS Lab #: 9207368-01N
Date Received: 07/29/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/29/92
Analysis Date: 07/29/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	1.8	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 213892CB GAGE
Sample Type: Wipe

CHAS Lab #: 9208018-01N
Date Received: 08/04/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 08/04/92
Analysis Date: 08/04/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	100 sq cm
PCB - Aroclor 1221	1.0	ND	100 sq cm
PCB - Aroclor 1232	1.0	ND	100 sq cm
PCB - Aroclor 1242	1.0	ND	100 sq cm
PCB - Aroclor 1248	1.0	ND	100 sq cm
PCB - Aroclor 1254	1.0	ND	100 sq cm
PCB - Aroclor 1260	1.0	ND	100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 100 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: DS7992-W1 DRUM STORAGE
Sample Type: Wipe

CHAS Lab #: 9207097-01N
Date Received: 07/10/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/10/92
Analysis Date: 07/10/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.6	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: DS7992-W2 DRUM STORAGE
Sample Type: Wipe

CHAS Lab #: 9207097-02N
Date Received: 07/10/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/10/92
Analysis Date: 07/10/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: DS7992-W3 DRUM STORAGE
Sample Type: Wipe

CHAS Lab #: 9207097-03N
Date Received: 07/10/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/10/92
Analysis Date: 07/10/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.7	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: DS7992-W4 DRUM STORAGE
Sample Type: Wipe

CHAS Lab #: 9207097-04N
Date Received: 07/10/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/10/92
Analysis Date: 07/10/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.1	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-1 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-01N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-2 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-02N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-3 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-03N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-4 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-04N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-5 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-05N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-6 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-06N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-7 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-07N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	ND	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2172092-8 GAGE
Sample Type: Wipe

CHAS Lab #: 9207249-08N
Date Received: 07/21/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 07/25/92
Analysis Date: 07/25/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-D2 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-08N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/14/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	15	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-D3 GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-09N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/14/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	67	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2142992-D4- GAGE
Sample Type: Wipe

CHAS Lab #: 9204462-10N
Date Received: 04/30/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 05/05/92
Analysis Date: 05/14/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	1.0	ND	ug/100 sq cm
PCB - Aroclor 1221	1.0	ND	ug/100 sq cm
PCB - Aroclor 1232	1.0	ND	ug/100 sq cm
PCB - Aroclor 1242	1.0	ND	ug/100 sq cm
PCB - Aroclor 1248	1.0	ND	ug/100 sq cm
PCB - Aroclor 1254	1.0	ND	ug/100 sq cm
PCB - Aroclor 1260	1.0	25	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-PC1 , GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-01N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.4	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2161292-PC1 GAGE
Sample Type: Wipe

CHAS Lab #: 9206208-01N
Date Received: 06/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/15/92
Analysis Date: 06/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-HWHSWITCH, GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-09N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.8	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2161292-HWH GAGE
Sample Type: Wipe

CHAS Lab #: 9206208-02N
Date Received: 06/15/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/15/92
Analysis Date: 06/15/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.6	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-PA, GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-01N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	6.0	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-PA GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-03N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-PB, GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-03N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	5.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-PB GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-04N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.4	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-PC-12, GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-04N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/02/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	2.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-PC2/JUNCTION, GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-02N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.6	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-LB-A , GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-02N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/01/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-LB-A, GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-05N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-LB-B , GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-05N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/02/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	4.6	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-LB-B, GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-06N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.3	ug/100 sq cm

Notes: ND = Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-L1-A , GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-07N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/02/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	1.5	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 216492-L1-A, GAGE
Sample Type: Wipe

CHAS Lab #: 9206074-07N
Date Received: 06/05/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/05/92
Analysis Date: 06/05/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.2	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.



Client: Clean Harbors of Kingston, Inc.
Sample I.D.: 2152992-L1-B , GAGE
Sample Type: Wipe

CHAS Lab #: 9205313-06N
Date Received: 06/01/92

Polychlorinated Biphenyls (PCBs)

Extraction Date: 06/01/92
Analysis Date: 06/02/92

Parameter	MDL	Concentration	Units
PCB - Aroclor 1016	0.1	ND	ug/100 sq cm
PCB - Aroclor 1221	0.1	ND	ug/100 sq cm
PCB - Aroclor 1232	0.1	ND	ug/100 sq cm
PCB - Aroclor 1242	0.1	ND	ug/100 sq cm
PCB - Aroclor 1248	0.1	ND	ug/100 sq cm
PCB - Aroclor 1254	0.1	ND	ug/100 sq cm
PCB - Aroclor 1260	0.1	0.9	ug/100 sq cm

Notes: ND - Below minimum detectable level (MDL)
Wipe Area: 900 sq cm

The sample was mixed with hexane for 5 minutes. The resulting extract was analyzed by GC/ECD following EPA Method 8080.